


Campylobacter jejuni (water source: groundwater):


min = 0.000000, max = 10.000000

Reference: [WHO GDWQ (2004)](http://www.who.int/water_sanitation_health/dwq/GDWQ2004web.pdf)

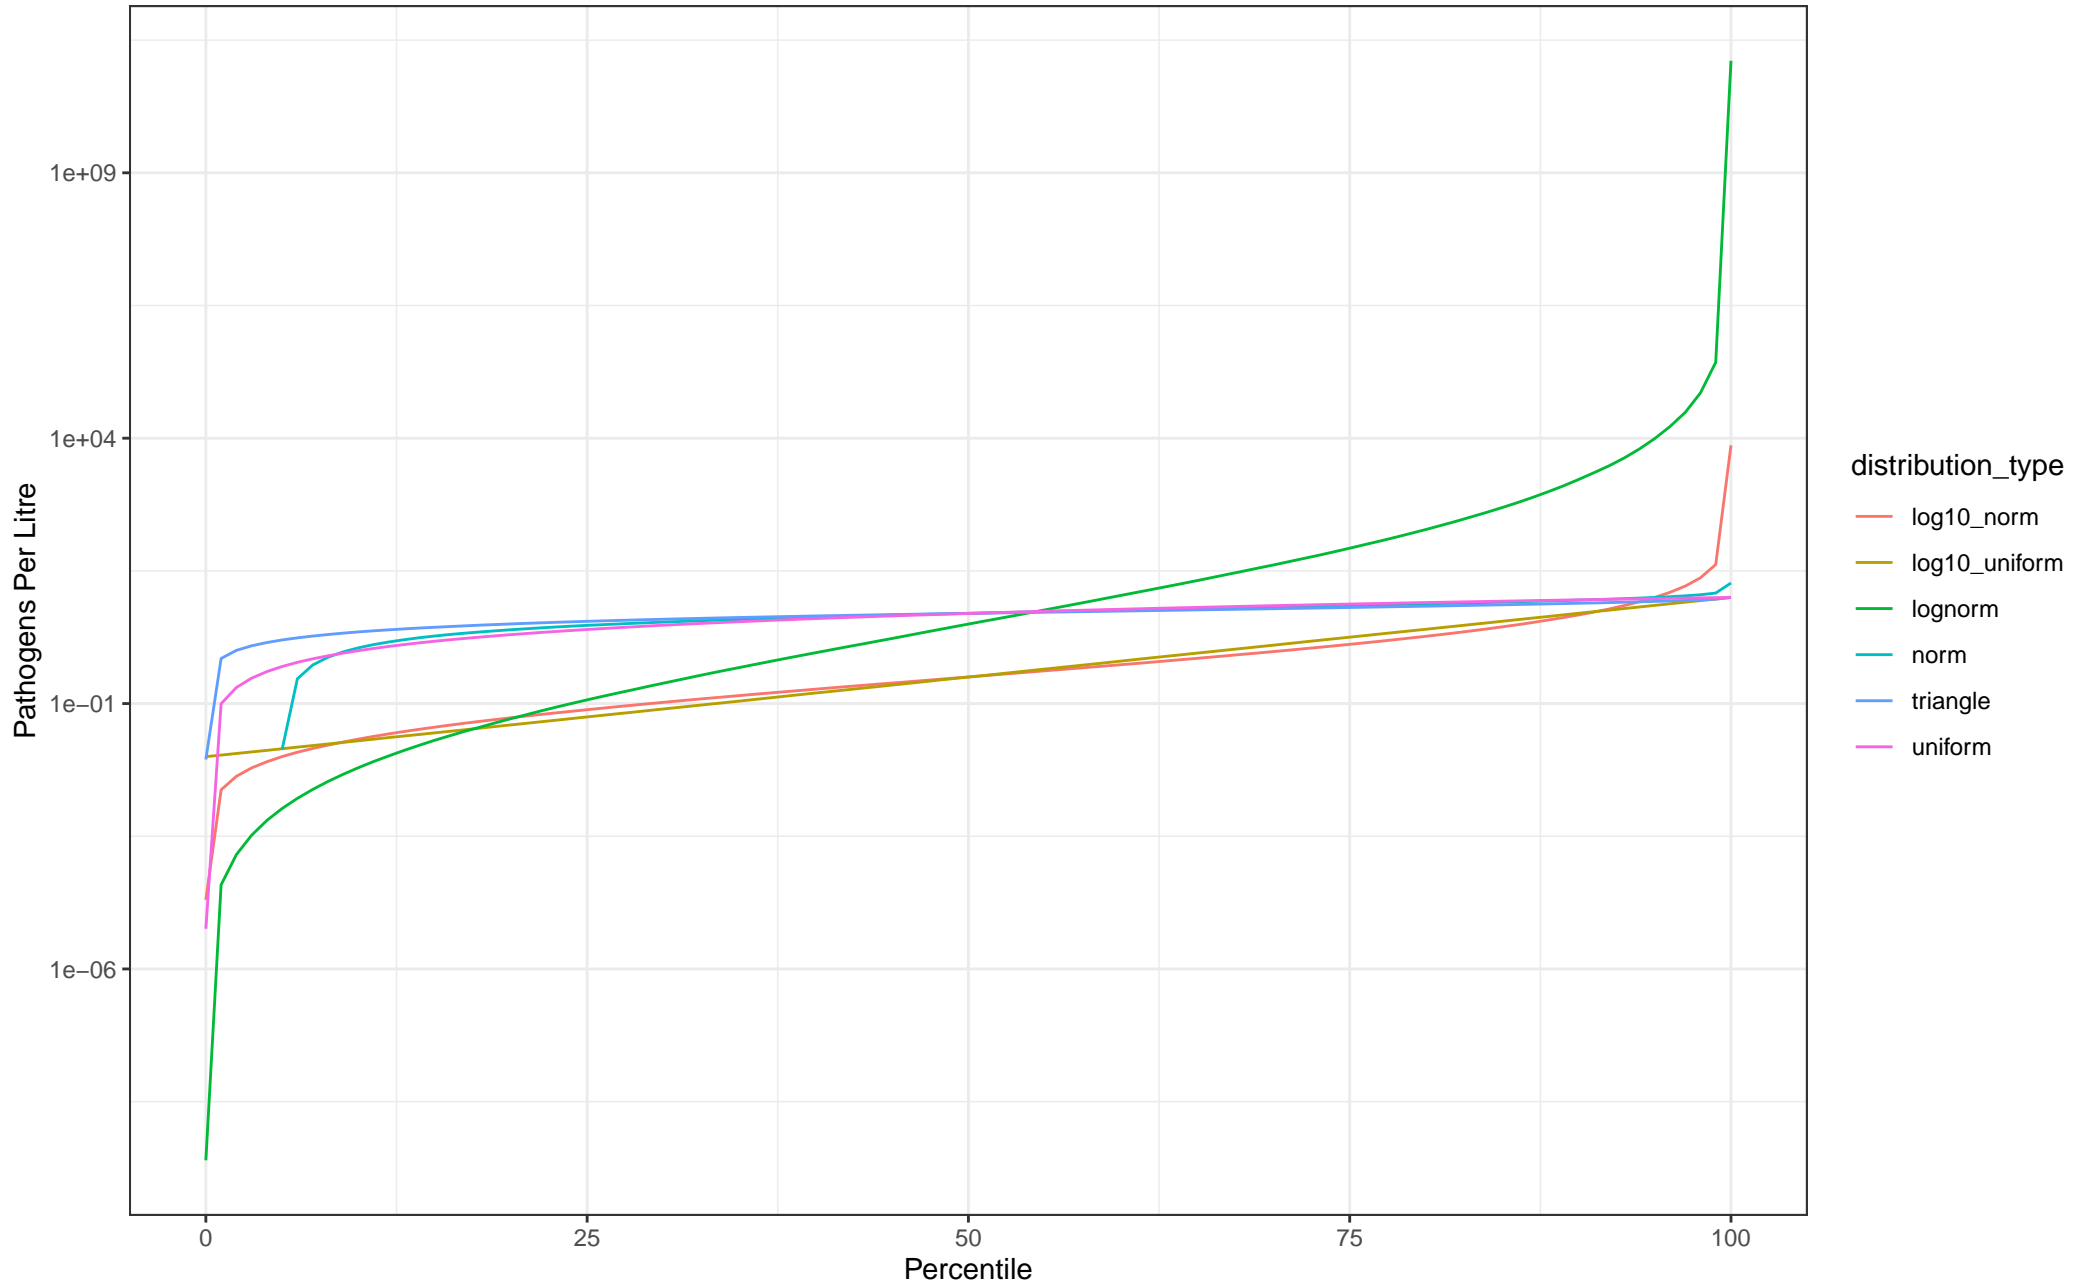


Cryptosporidium parvum (water source: groundwater):
min = 0.000000, max = 1.000000

Reference: [WHO GDWQ (2004)](http://www.who.int/water_sanitation_health/dwq/GDWQ2004web.pdf)

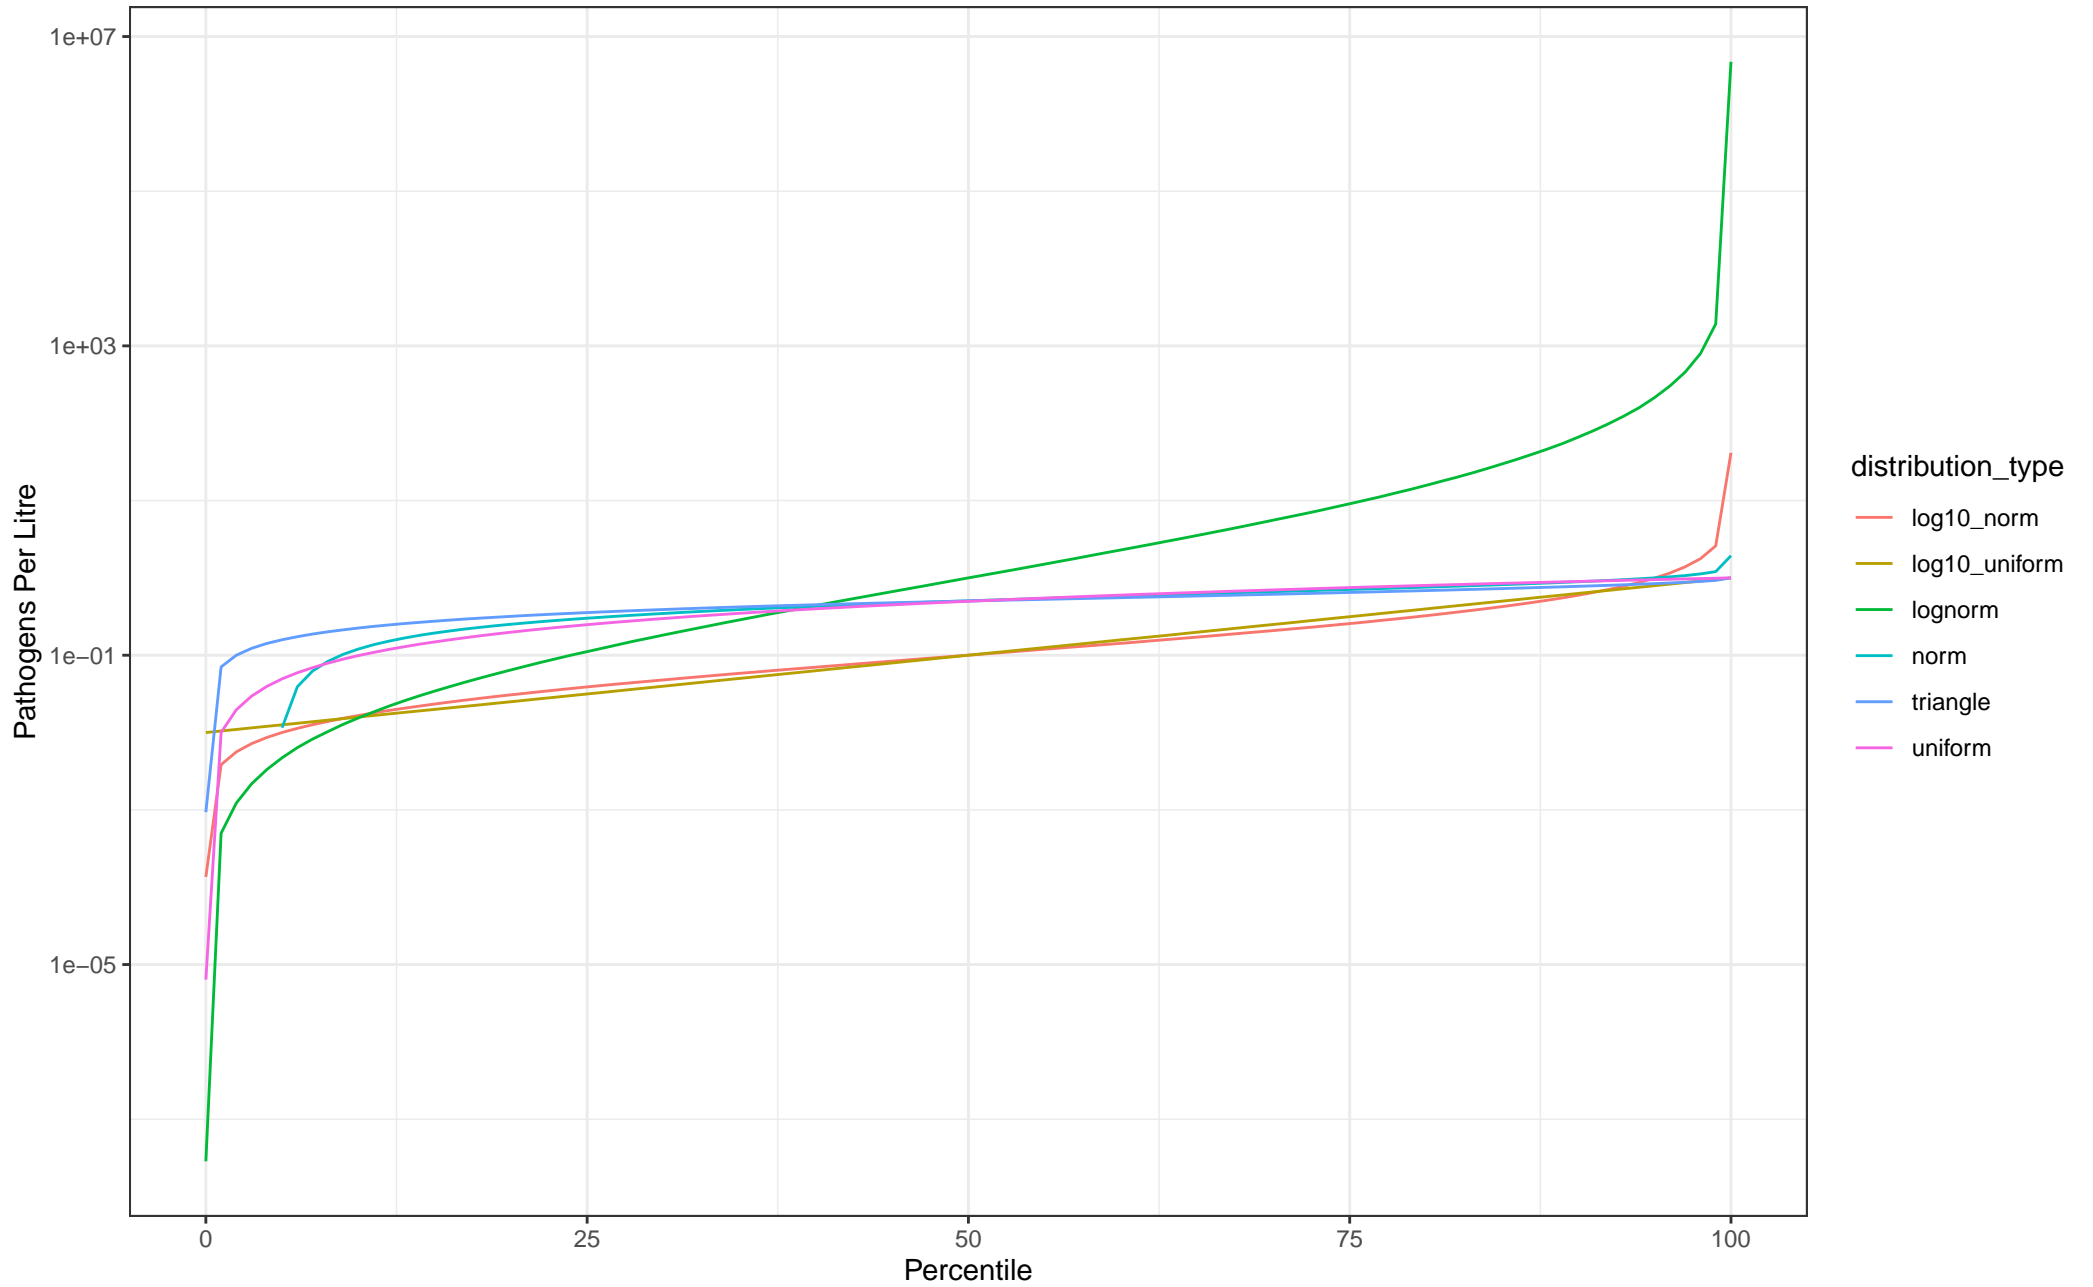


Rotavirus (water source: groundwater):
min = 0.000000, max = 2.000000


Reference: [WHO GDWQ (2004)](http://www.who.int/water_sanitation_health/dwq/GDWQ2004web.pdf)

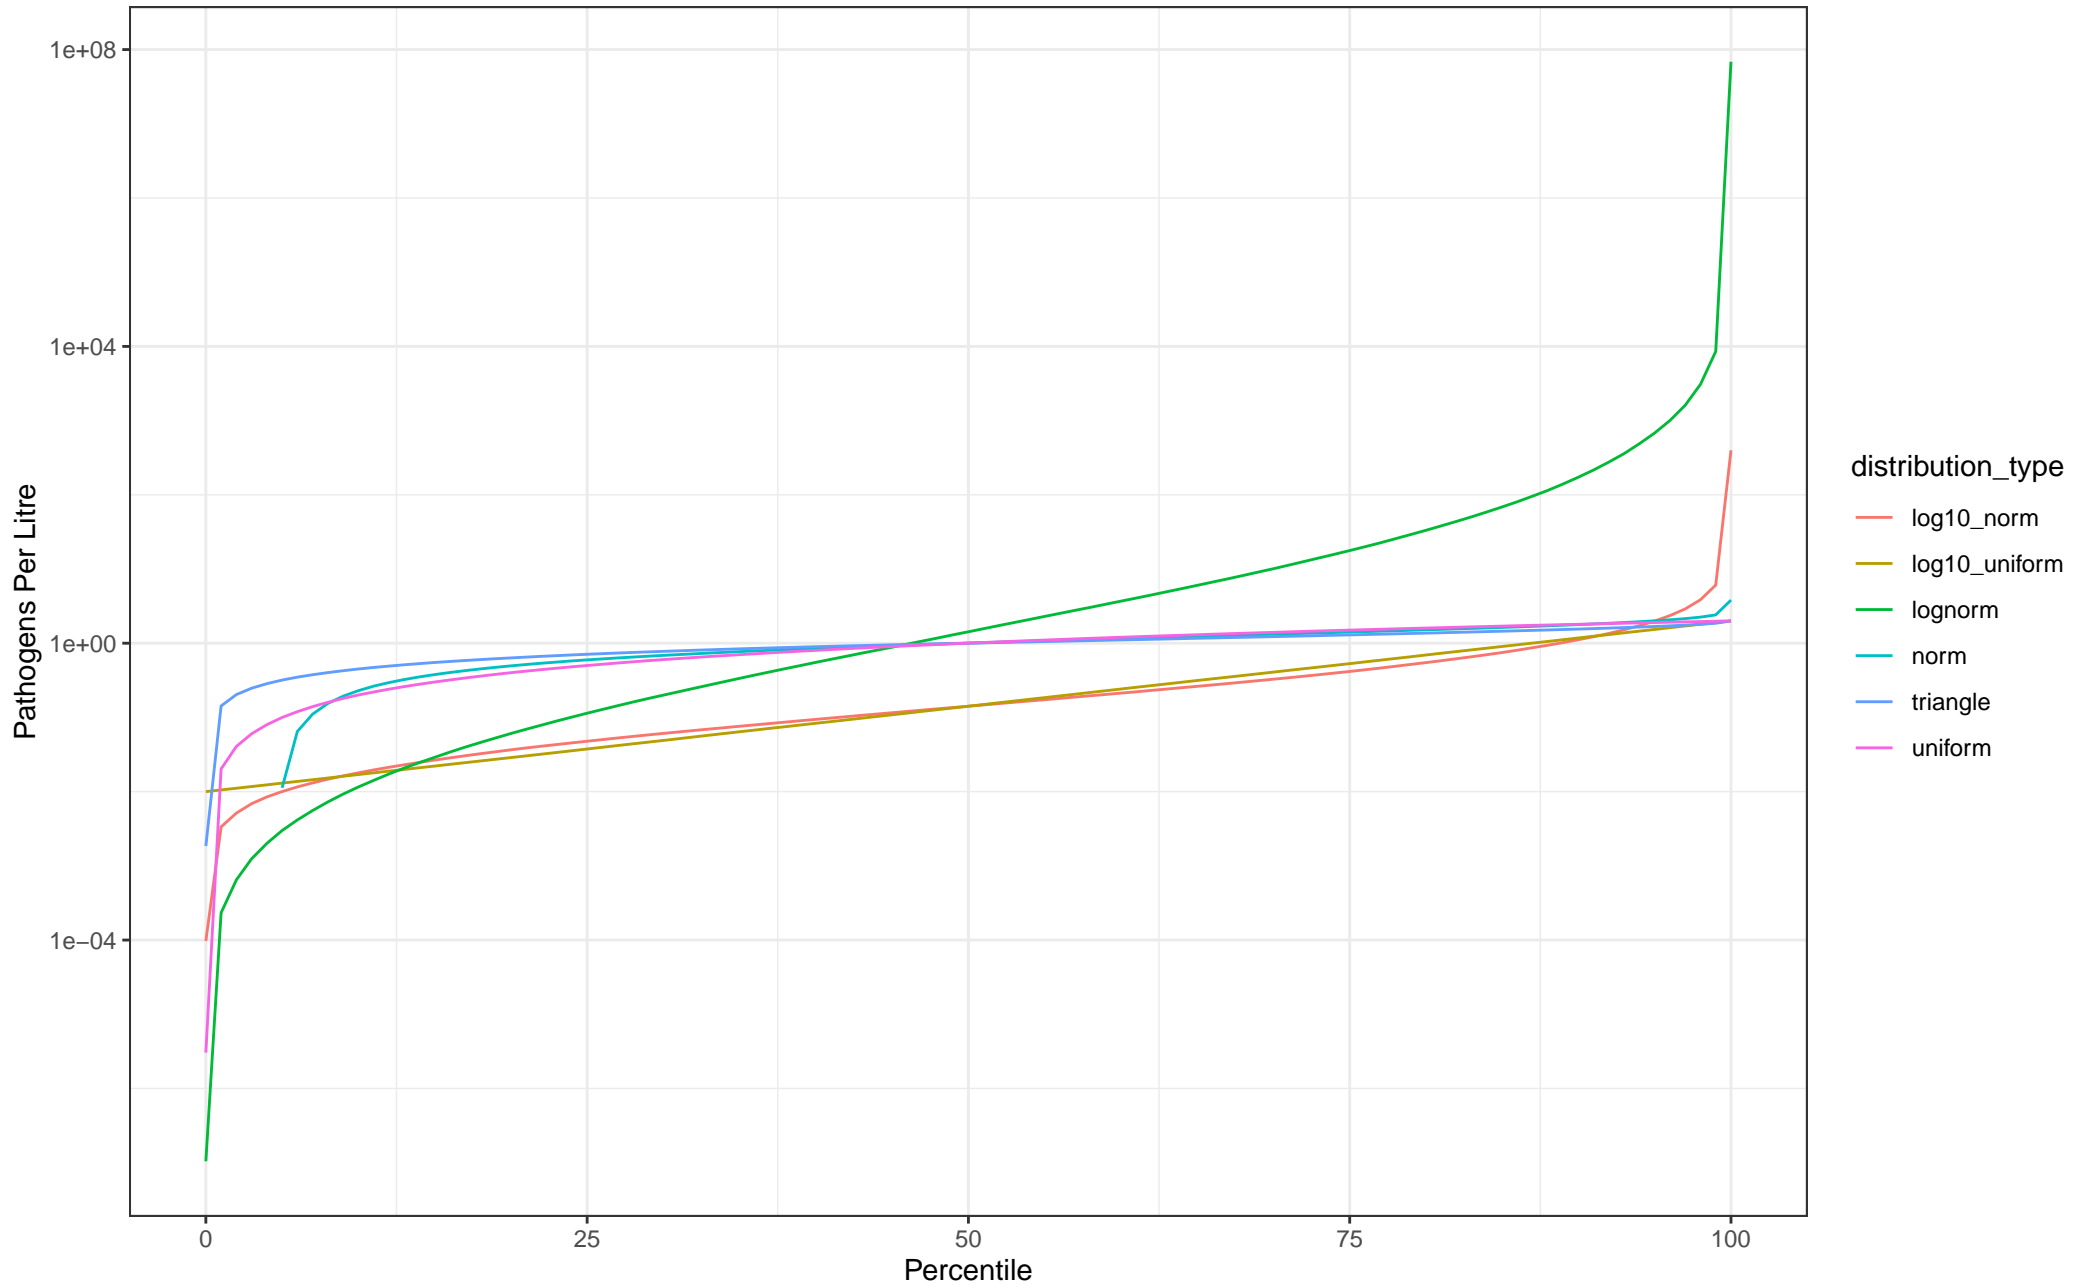

Campylobacter jejuni (water source: rainwater, rooftop harvesting):
min = 0.000000, max = 24.000000
Reference: [KWR 2016.081](https://library.kwrwater.nl/publication/54026237/)

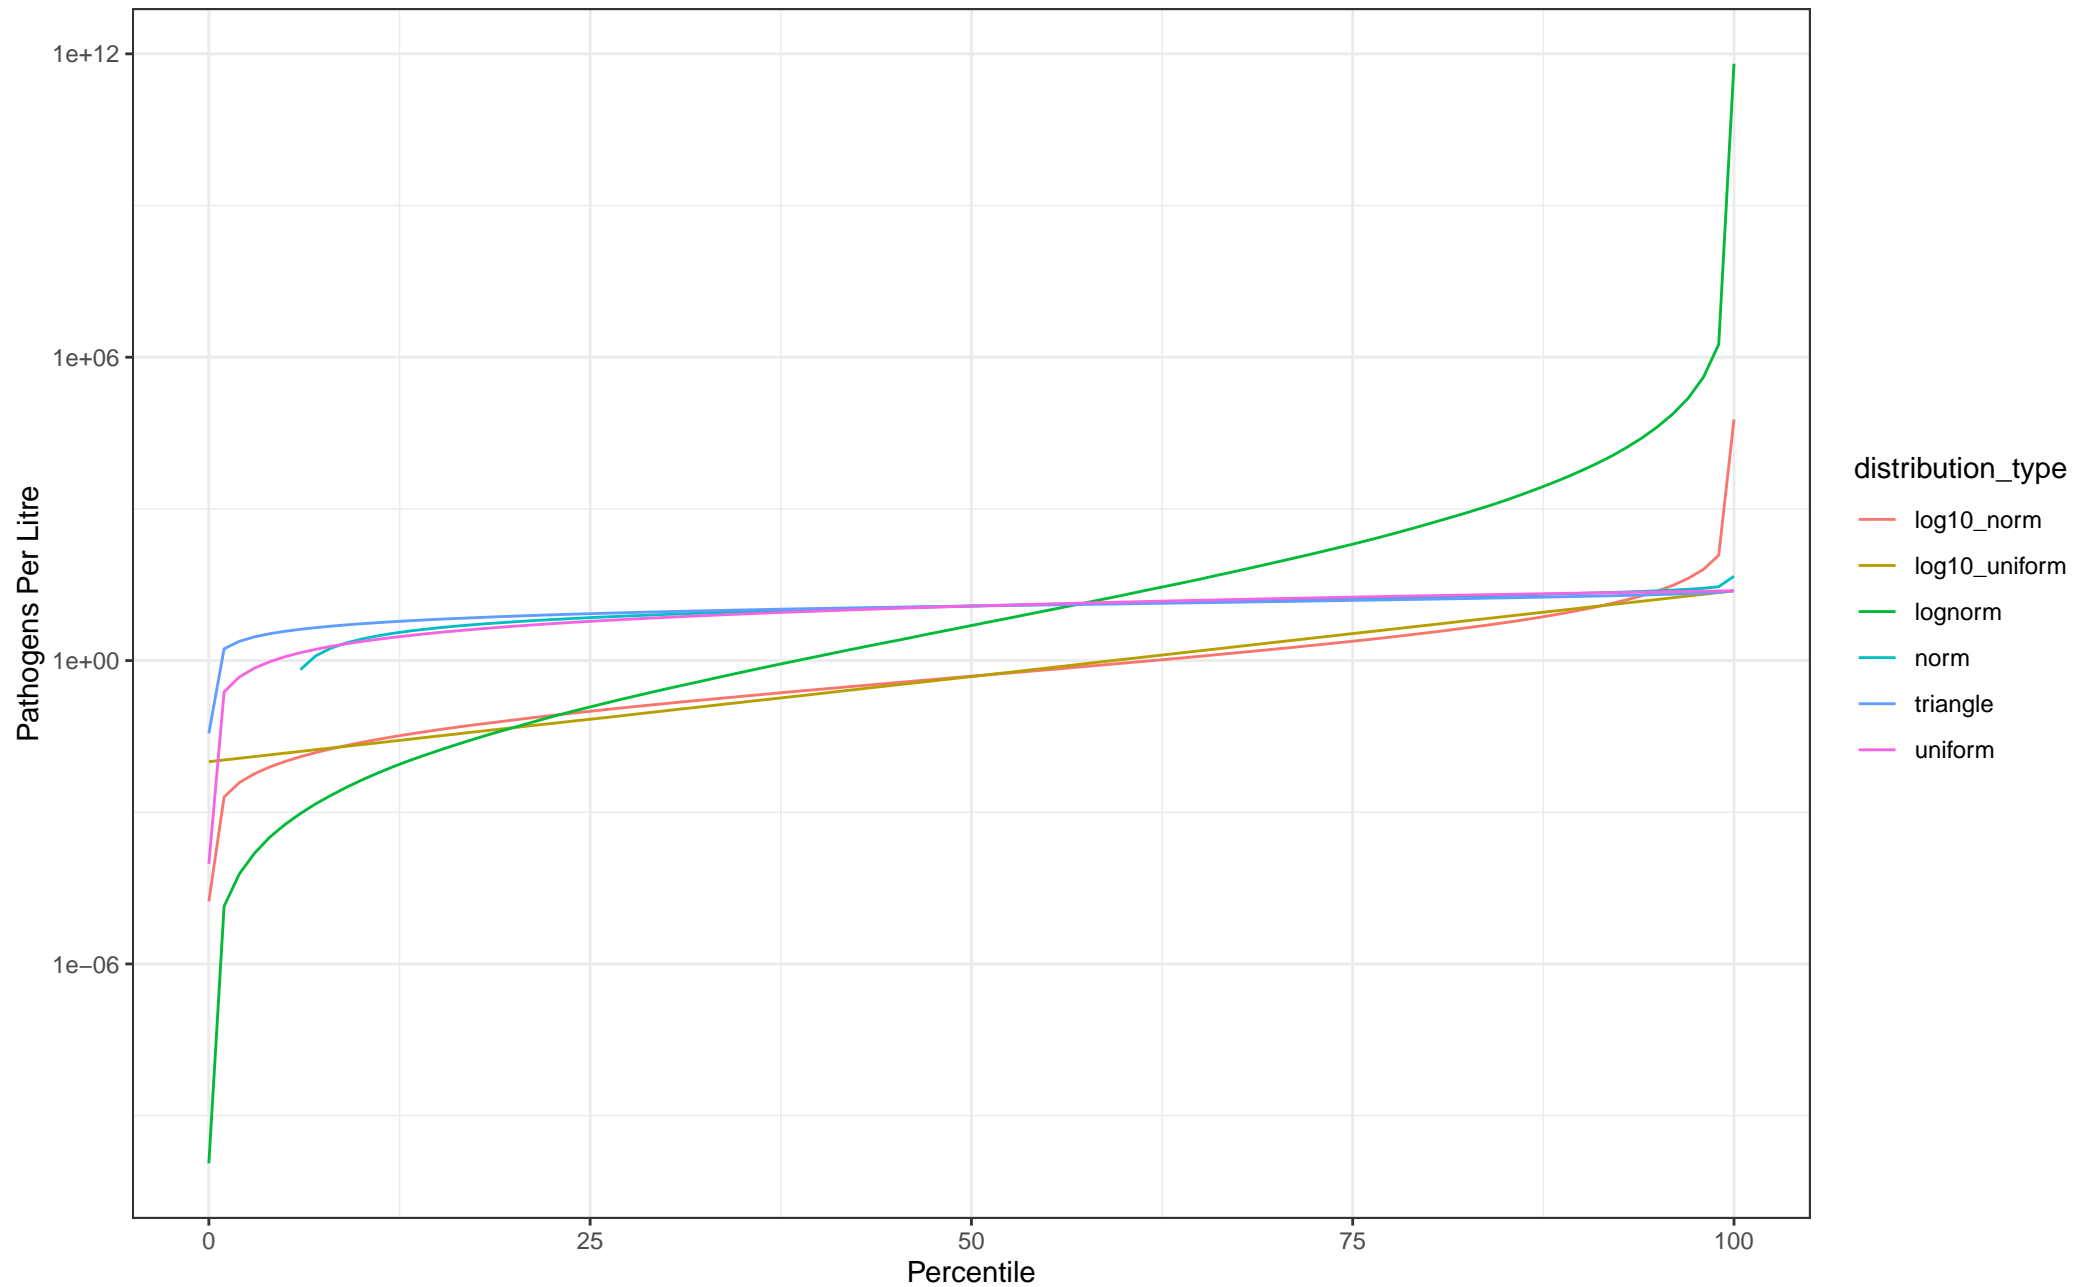


Cryptosporidium parvum (water source: rainwater, rooftop harvesting):
min = 0.000000, max = 0.190000
Reference: [KWR 2016.081](https://library.kwrwater.nl/publication/54026237/)

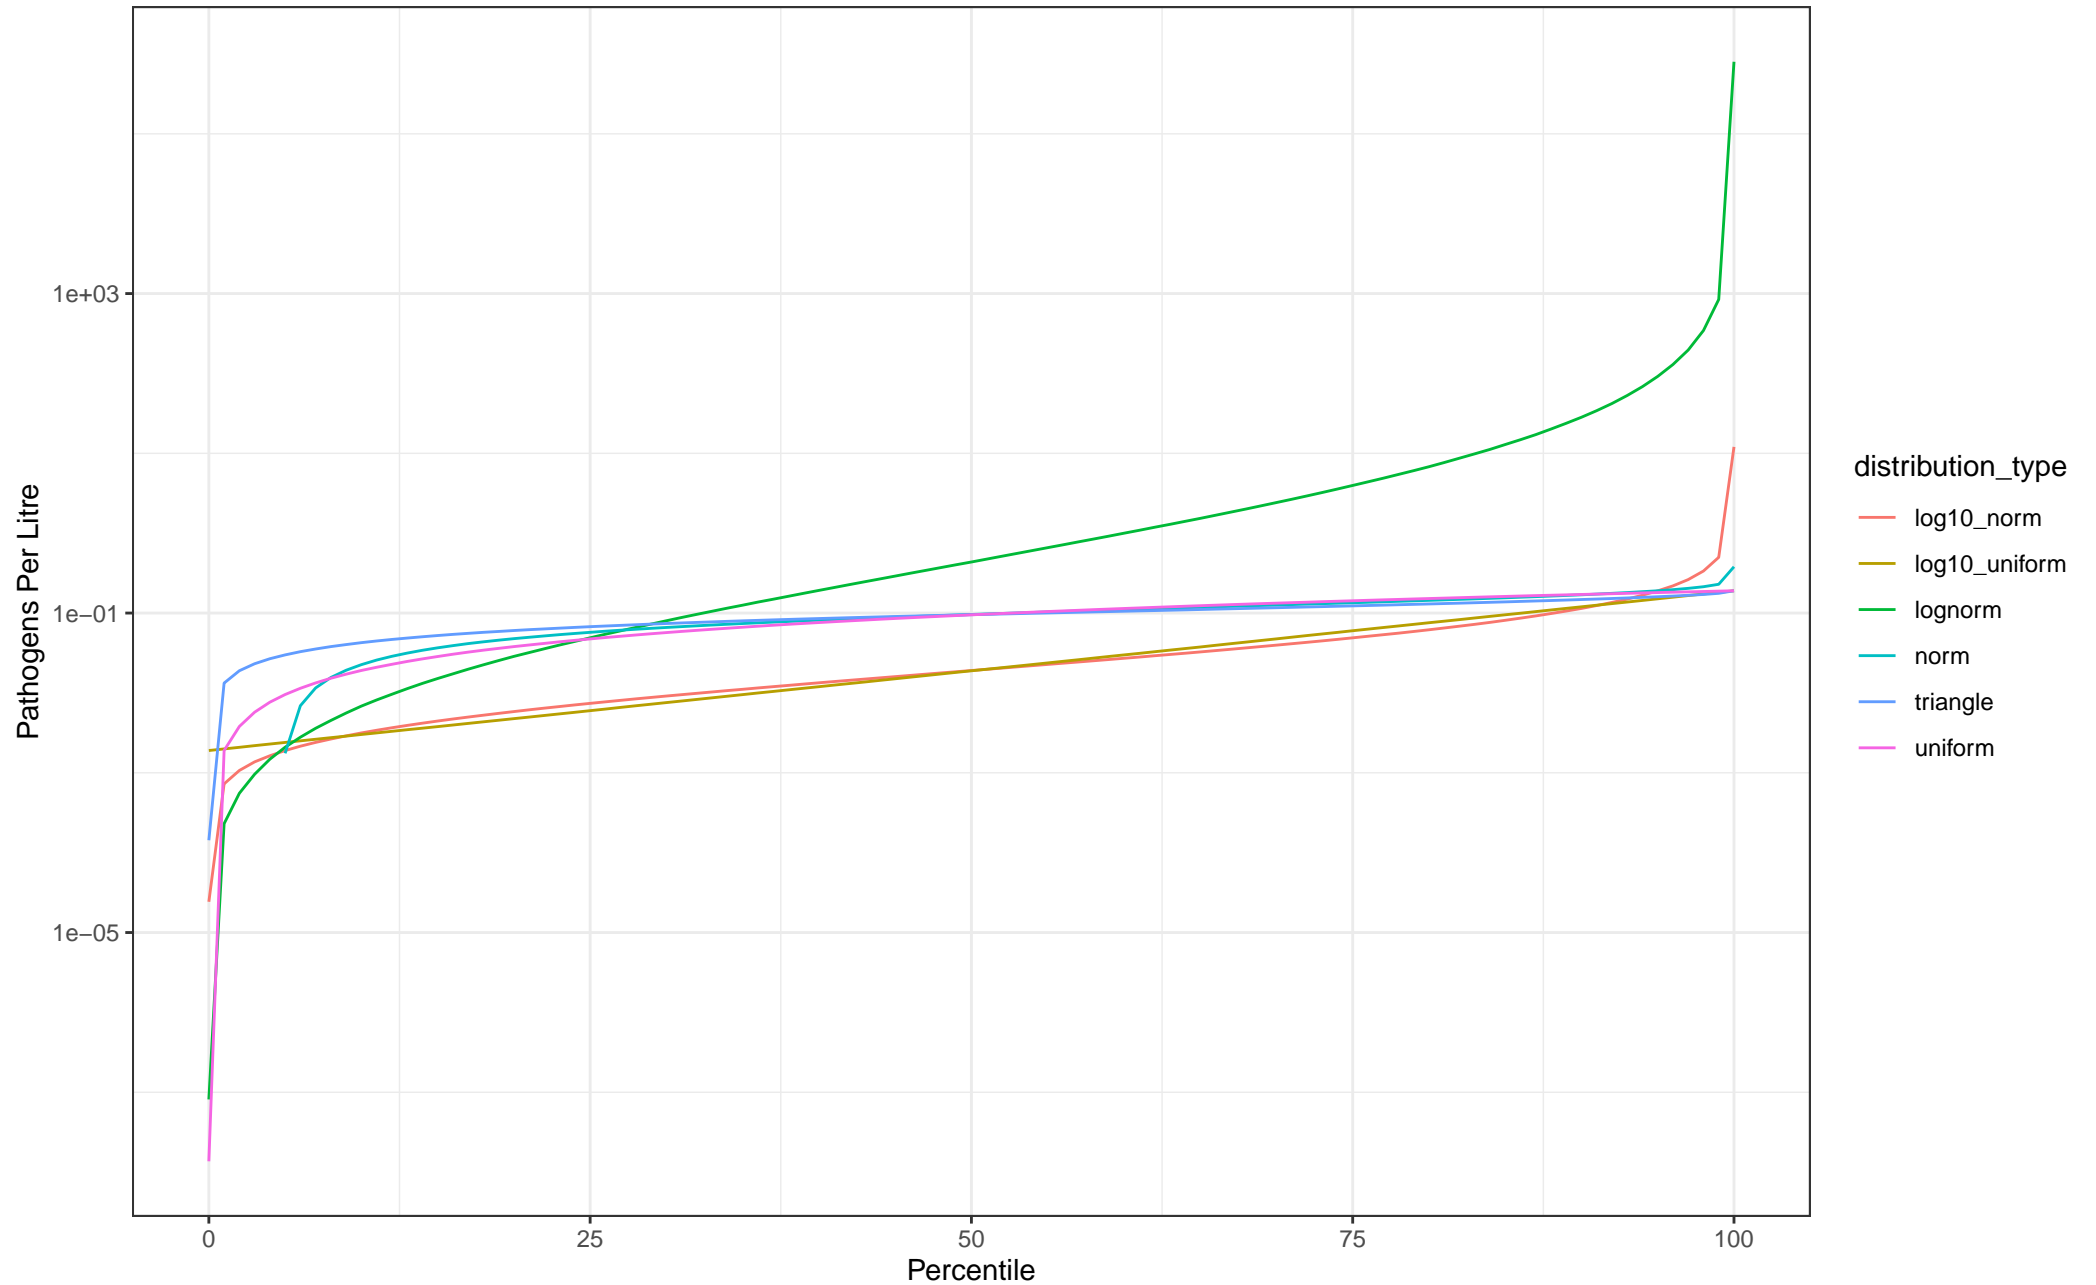

Rotavirus (water source: rainwater, rooftop harvesting):


min = 0.000000, max = 0.010000

Reference: [KWR 2016.081](https://library.kwrwater.nl/publication/54026237/)

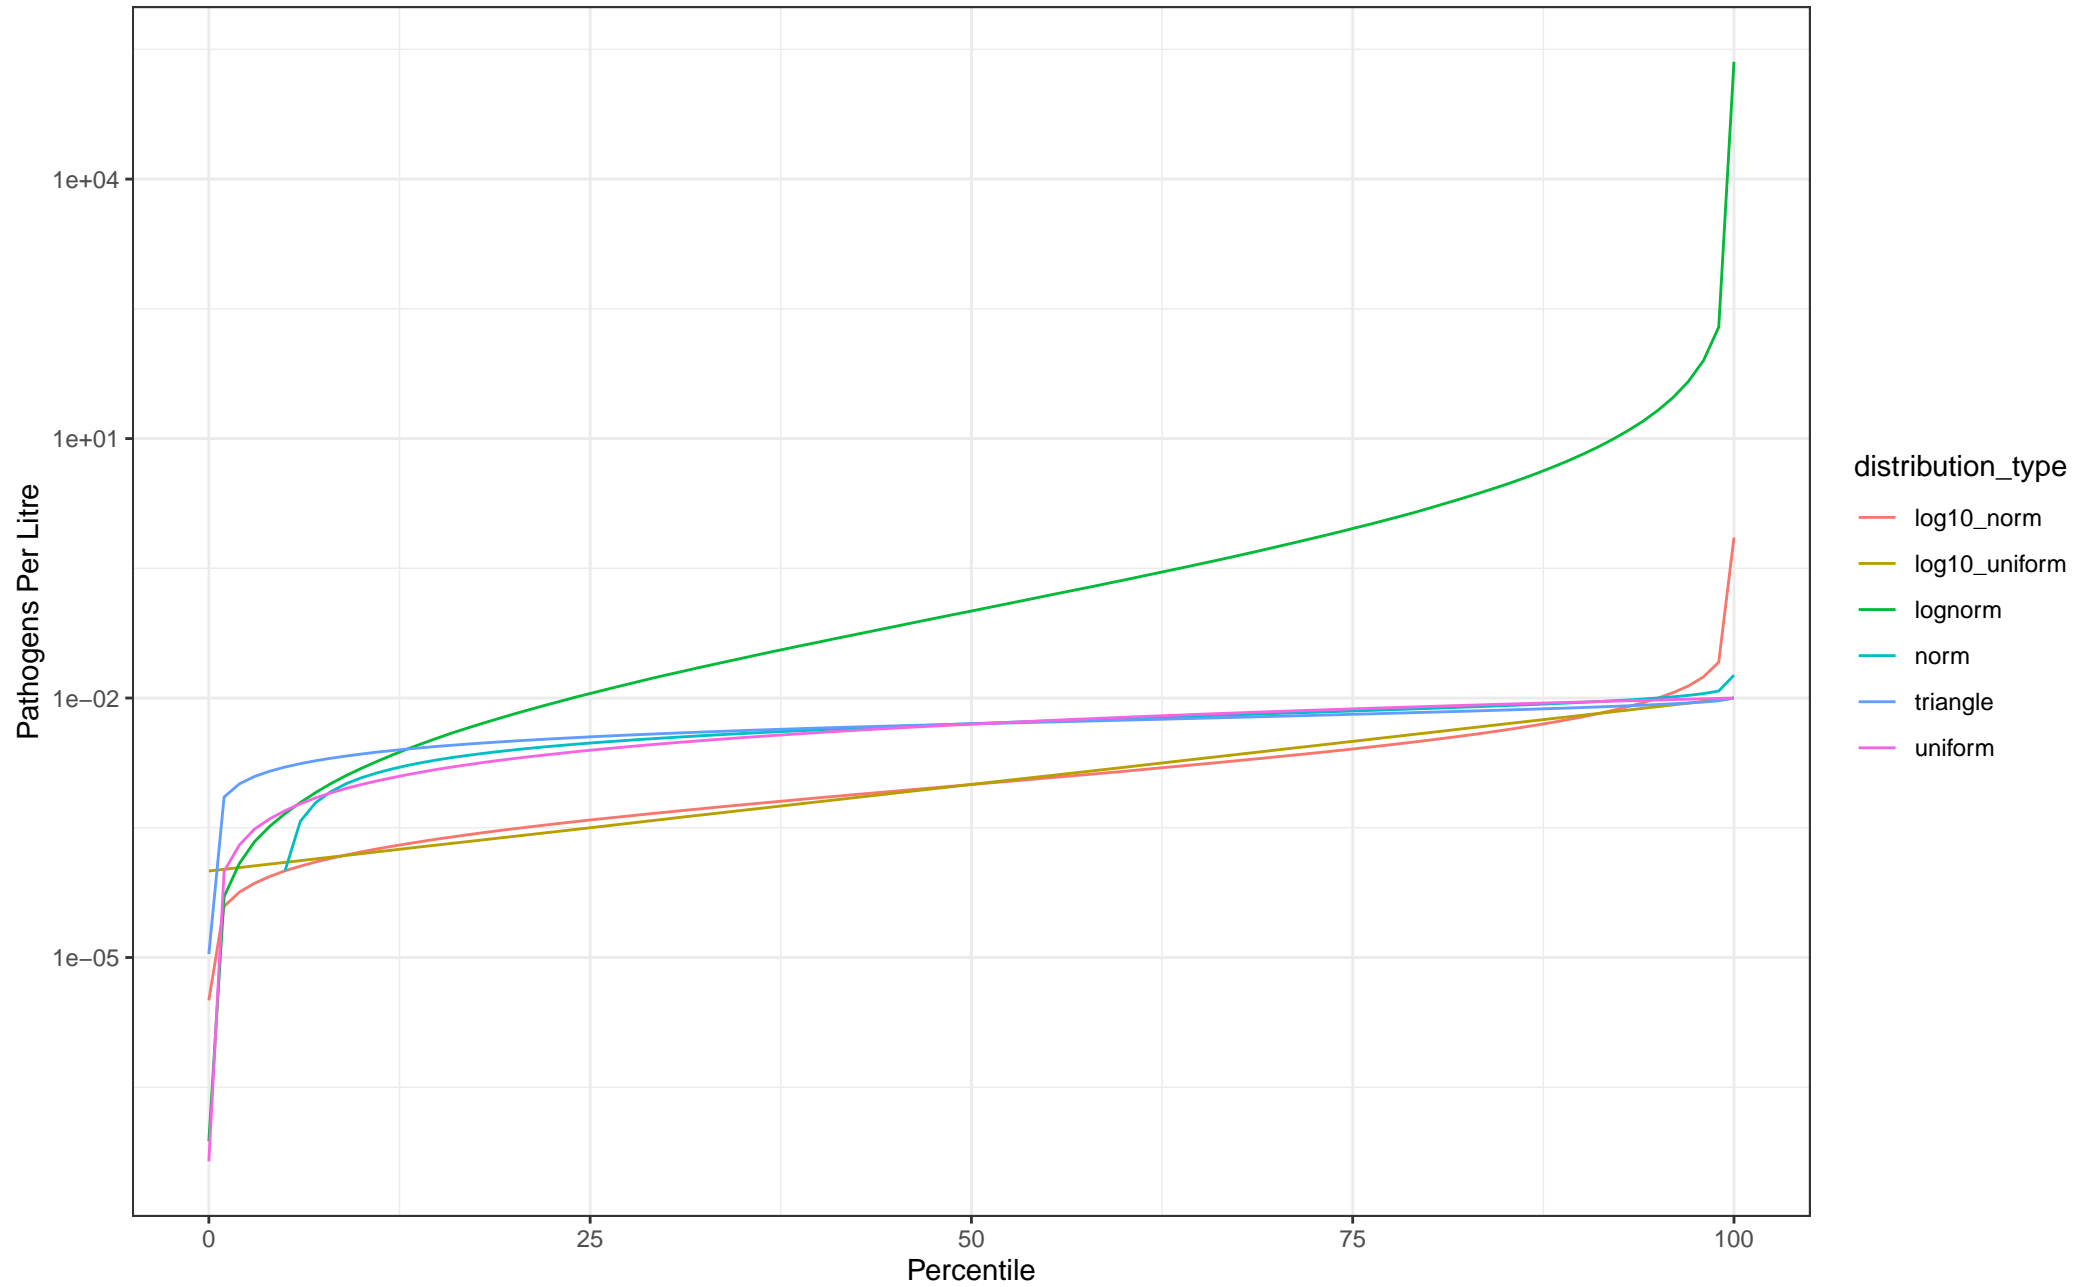


Campylobacter jejuni (water source: rainwater, stormwater harvesting):
min = 13.869428, max = 287.039359

Reference: [Sales Ortells 2015](https://repository.tudelft.nl/islandora/object/uuid:0e41d07b-9f44-4220-aaac-e22c73c5074a?collection=research)

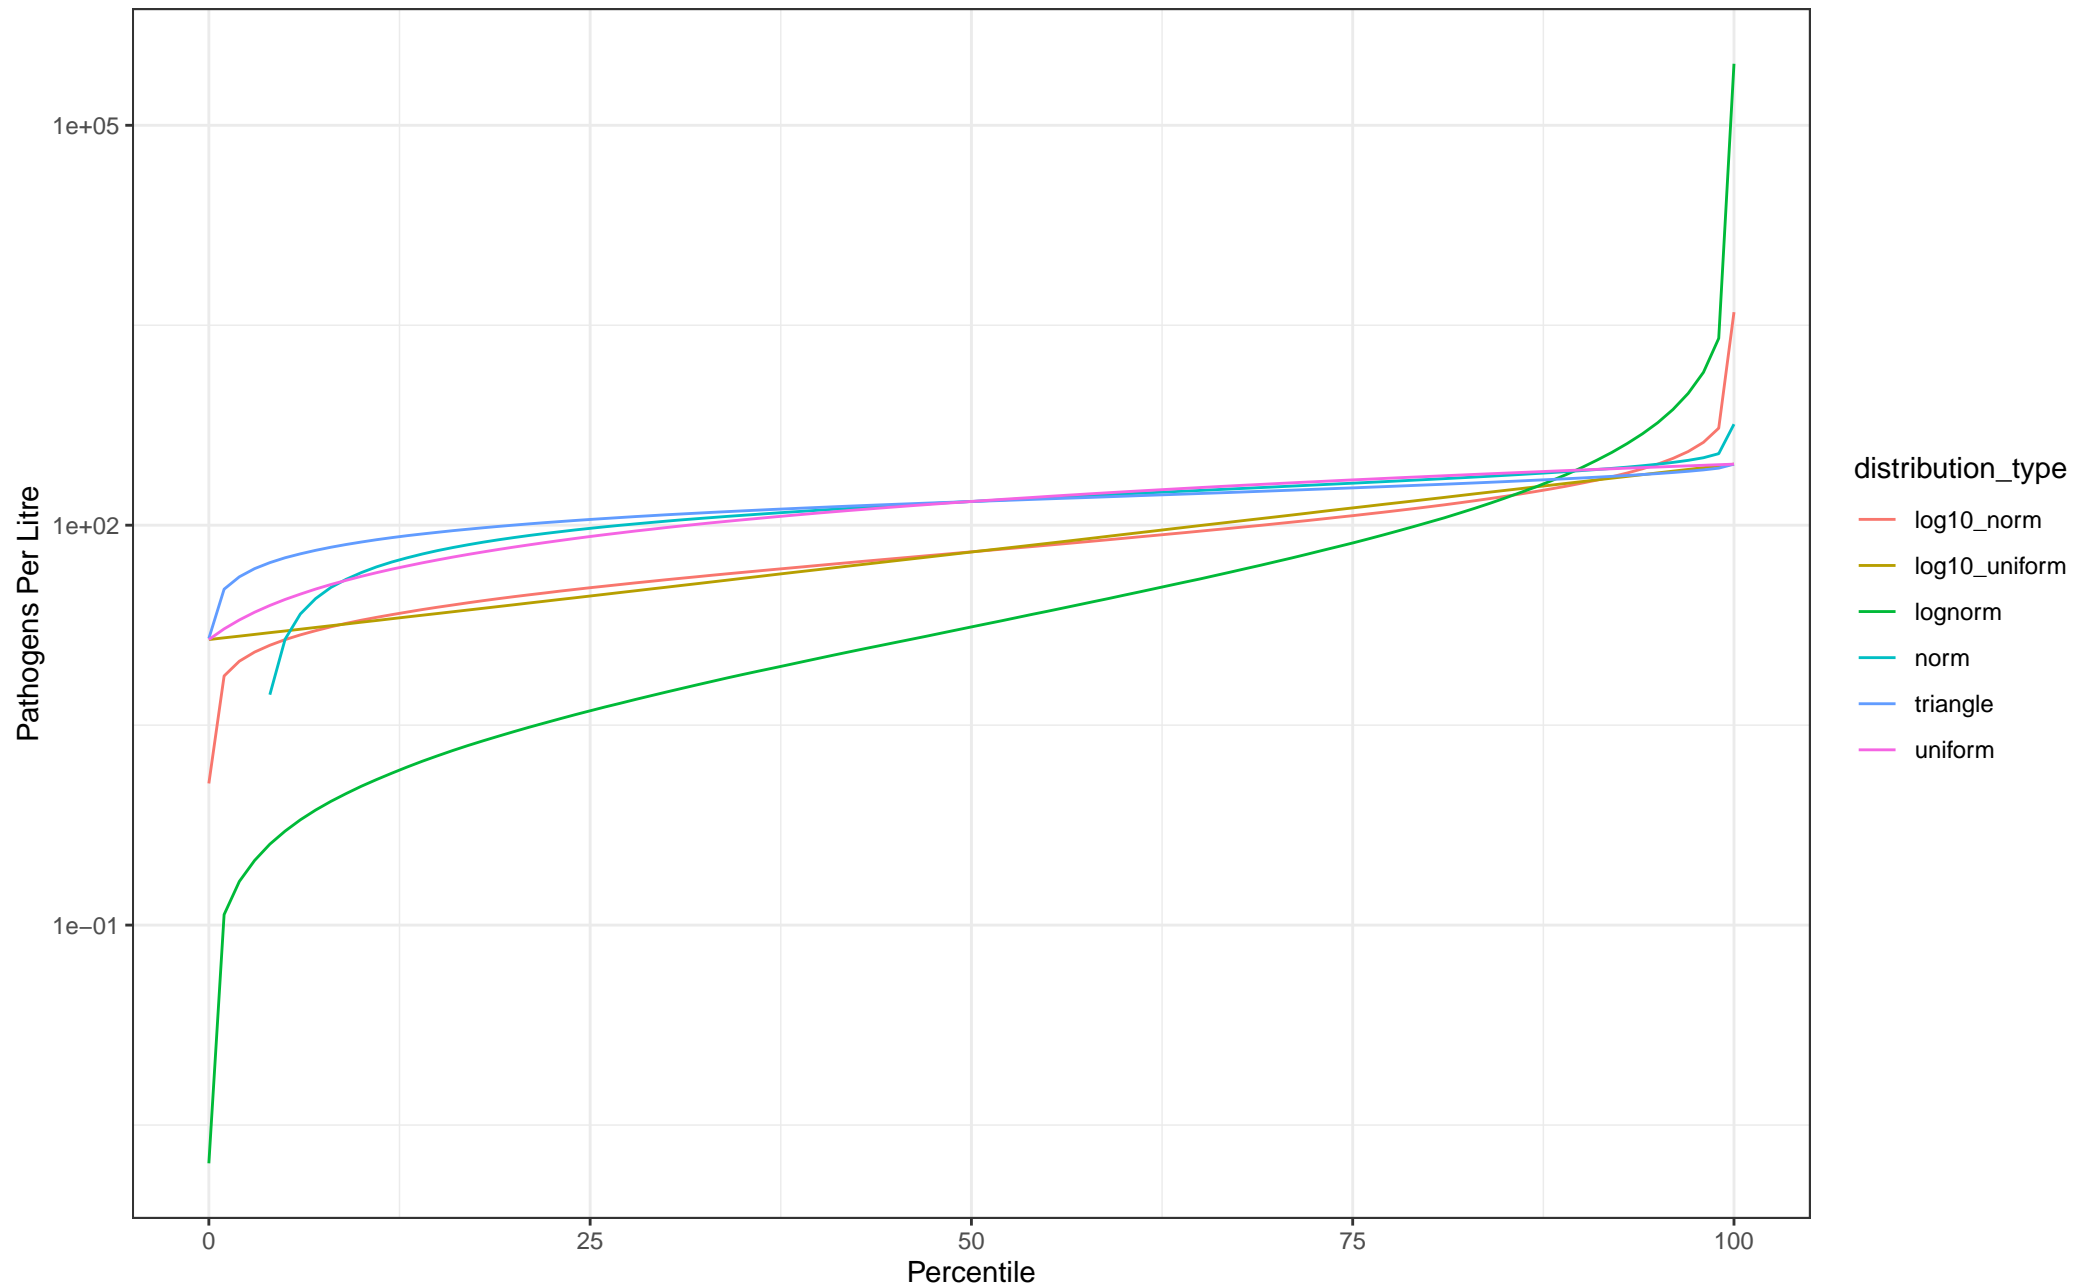

Cryptosporidium parvum (water source: rainwater, stormwater harvesting):
min = 0.000045, max = 0.088075


Reference: [Sales Ortells 2015](https://repository.tudelft.nl/islandora/object/uuid:0e41d07b-9f44-4220-aaac-e22c73c5074a?collection=research)

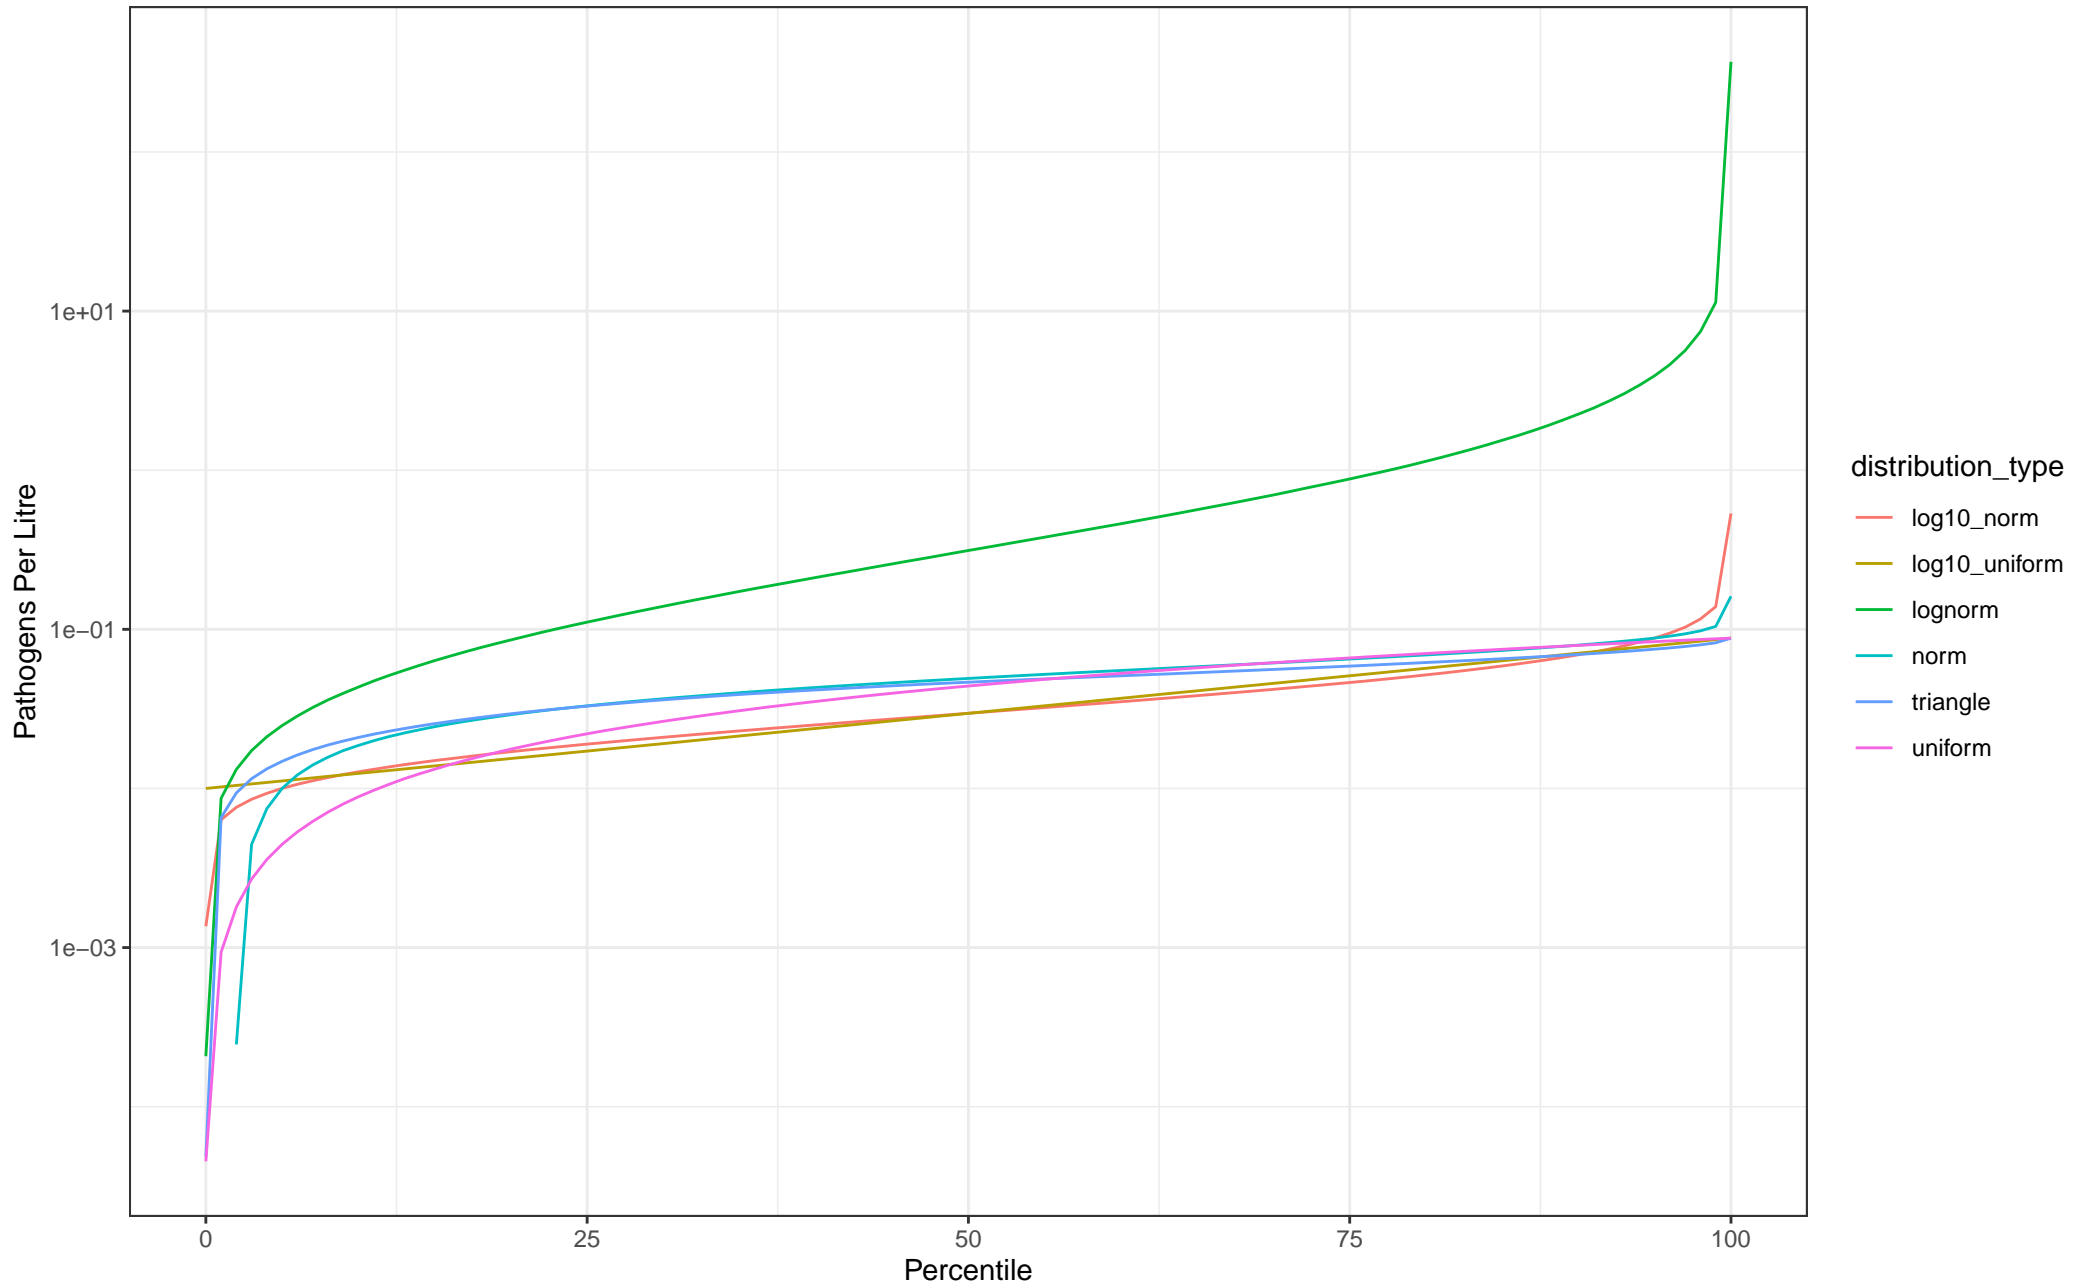

Rotavirus (water source: rainwater, stormwater harvesting):


min = 9.745107, max = 64.746069

Reference: [Sales Ortells 2015](https://repository.tudelft.nl/islandora/object/uuid:0e41d07b-9f44-4220-aaac-e22c73c5074a?collection=research)

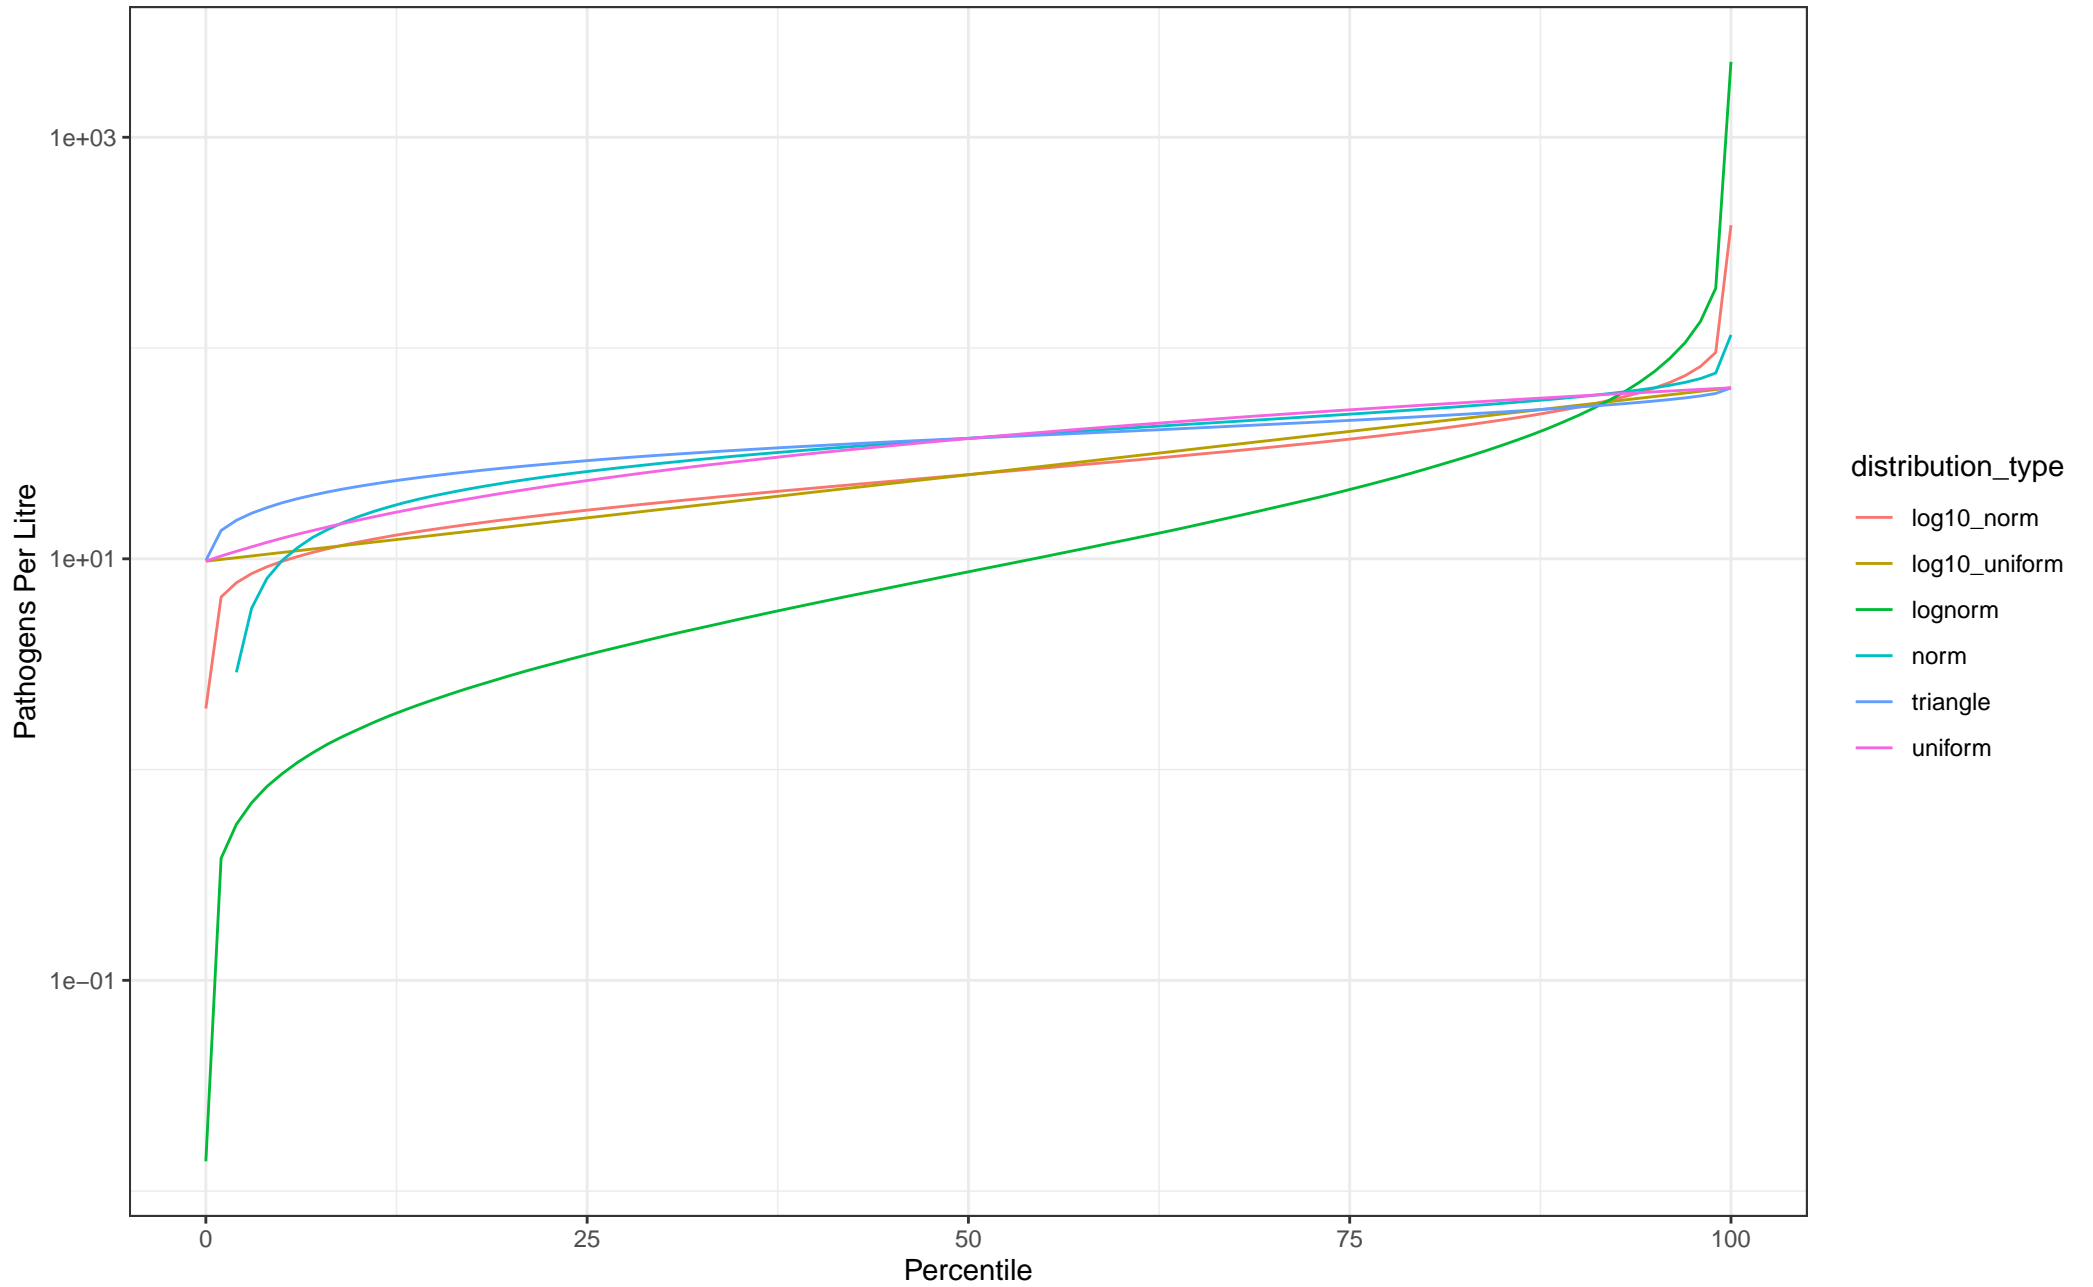


Campylobacter jejuni (water source: sewage, raw):
min = 100.000000, max = 1000000.000000

Reference: [WHO (2011): Drinking water guideline, Table 7.6](http://apps.who.int/iris/bitstream/10665/44584/1/9789241548151_eng.pdf#page=159)

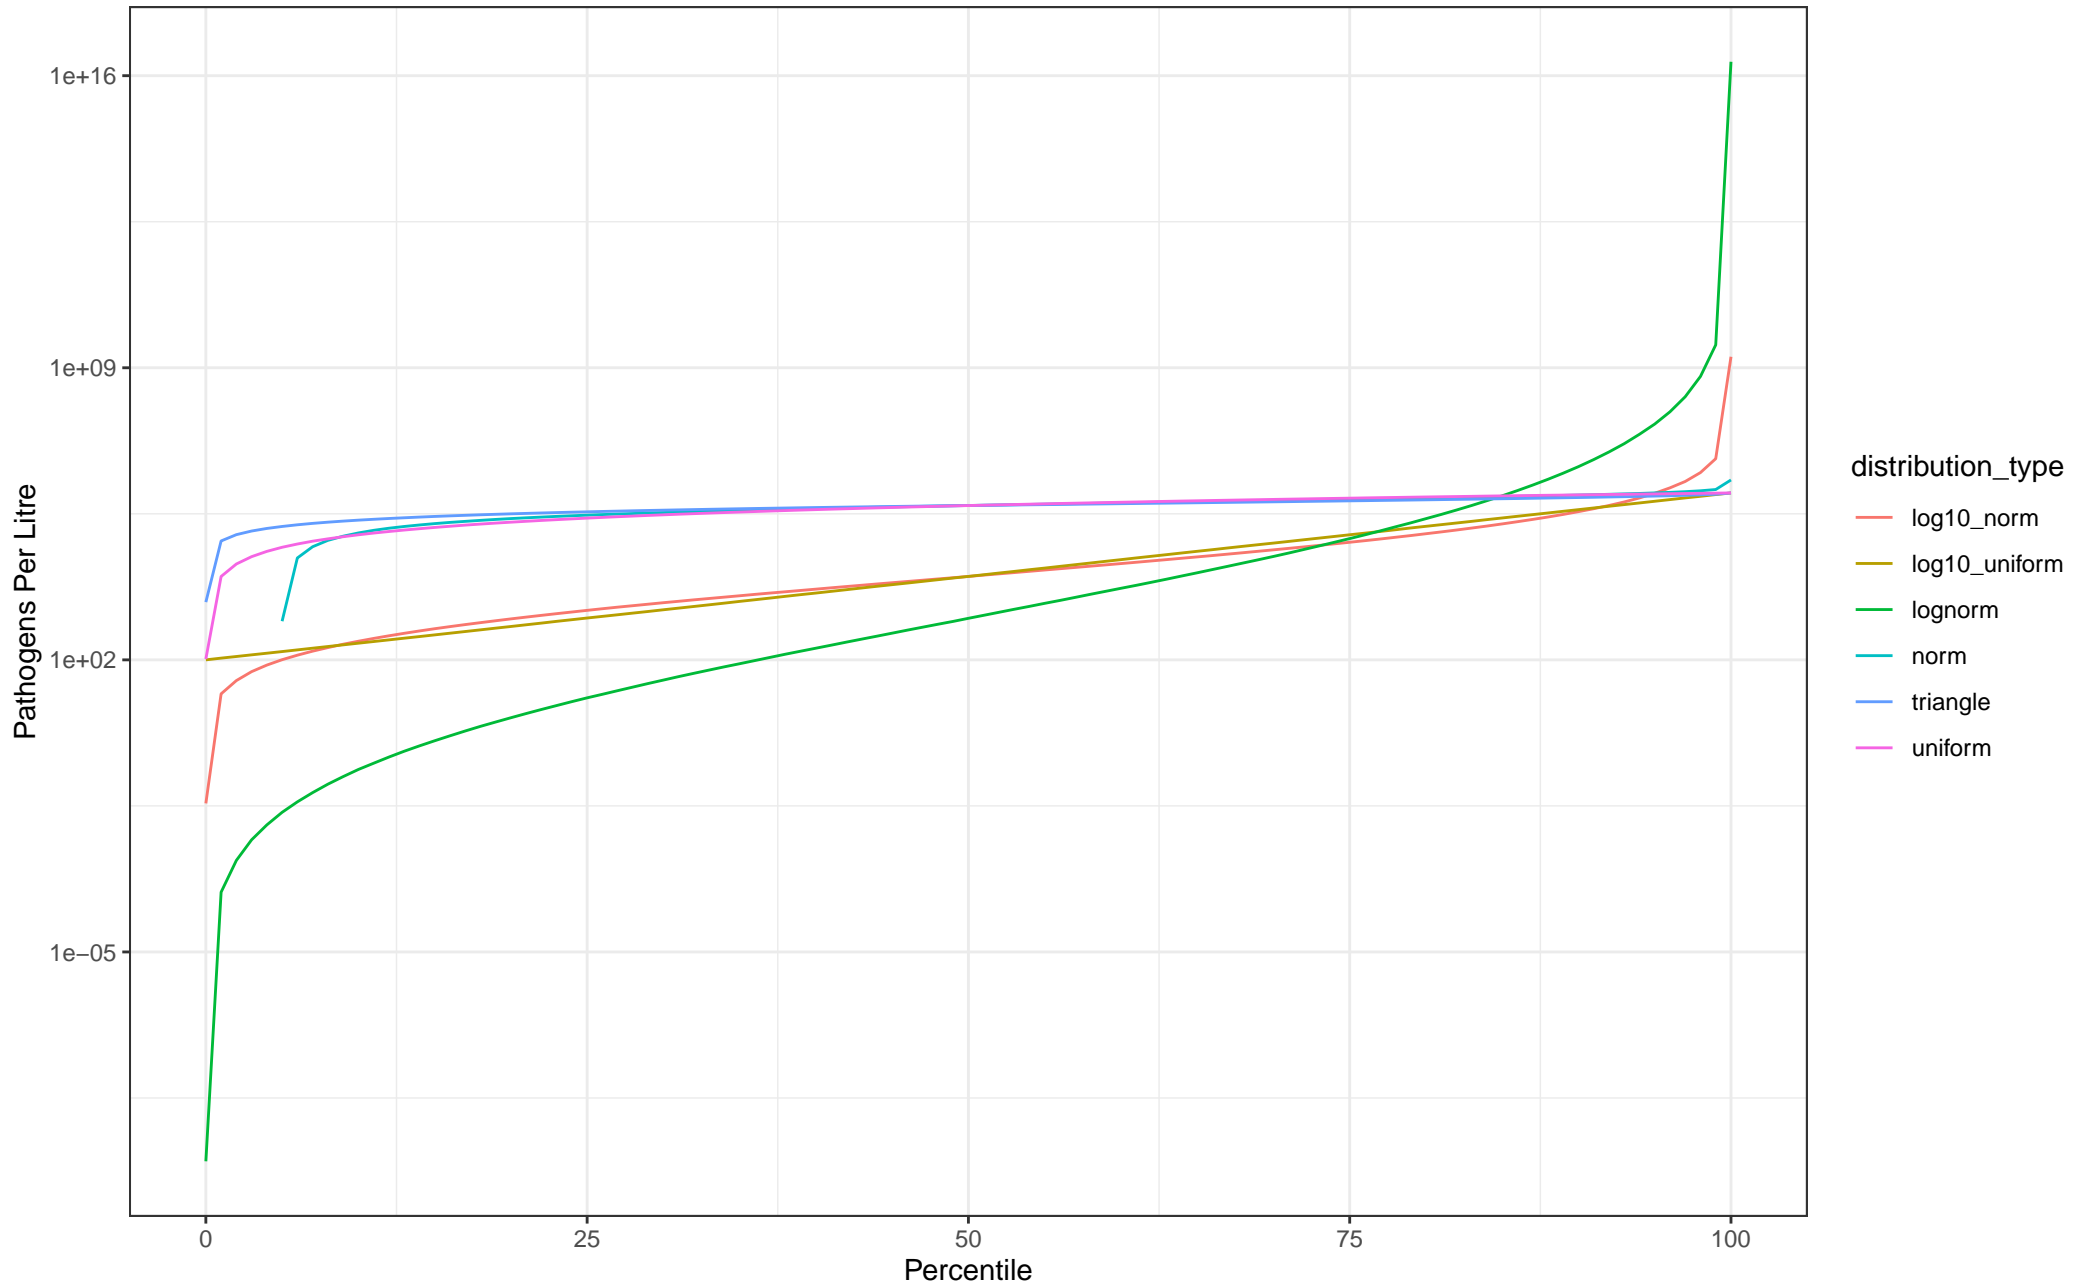


Escherichia coli (water source: sewage, raw):
min = 1000000.000000, max = 100000000000.000000

Reference: [WHO (2011): Drinking water guideline, Table 7.6](http://apps.who.int/iris/bitstream/10665/44584/1/9789241548151_eng.pdf#page=159)

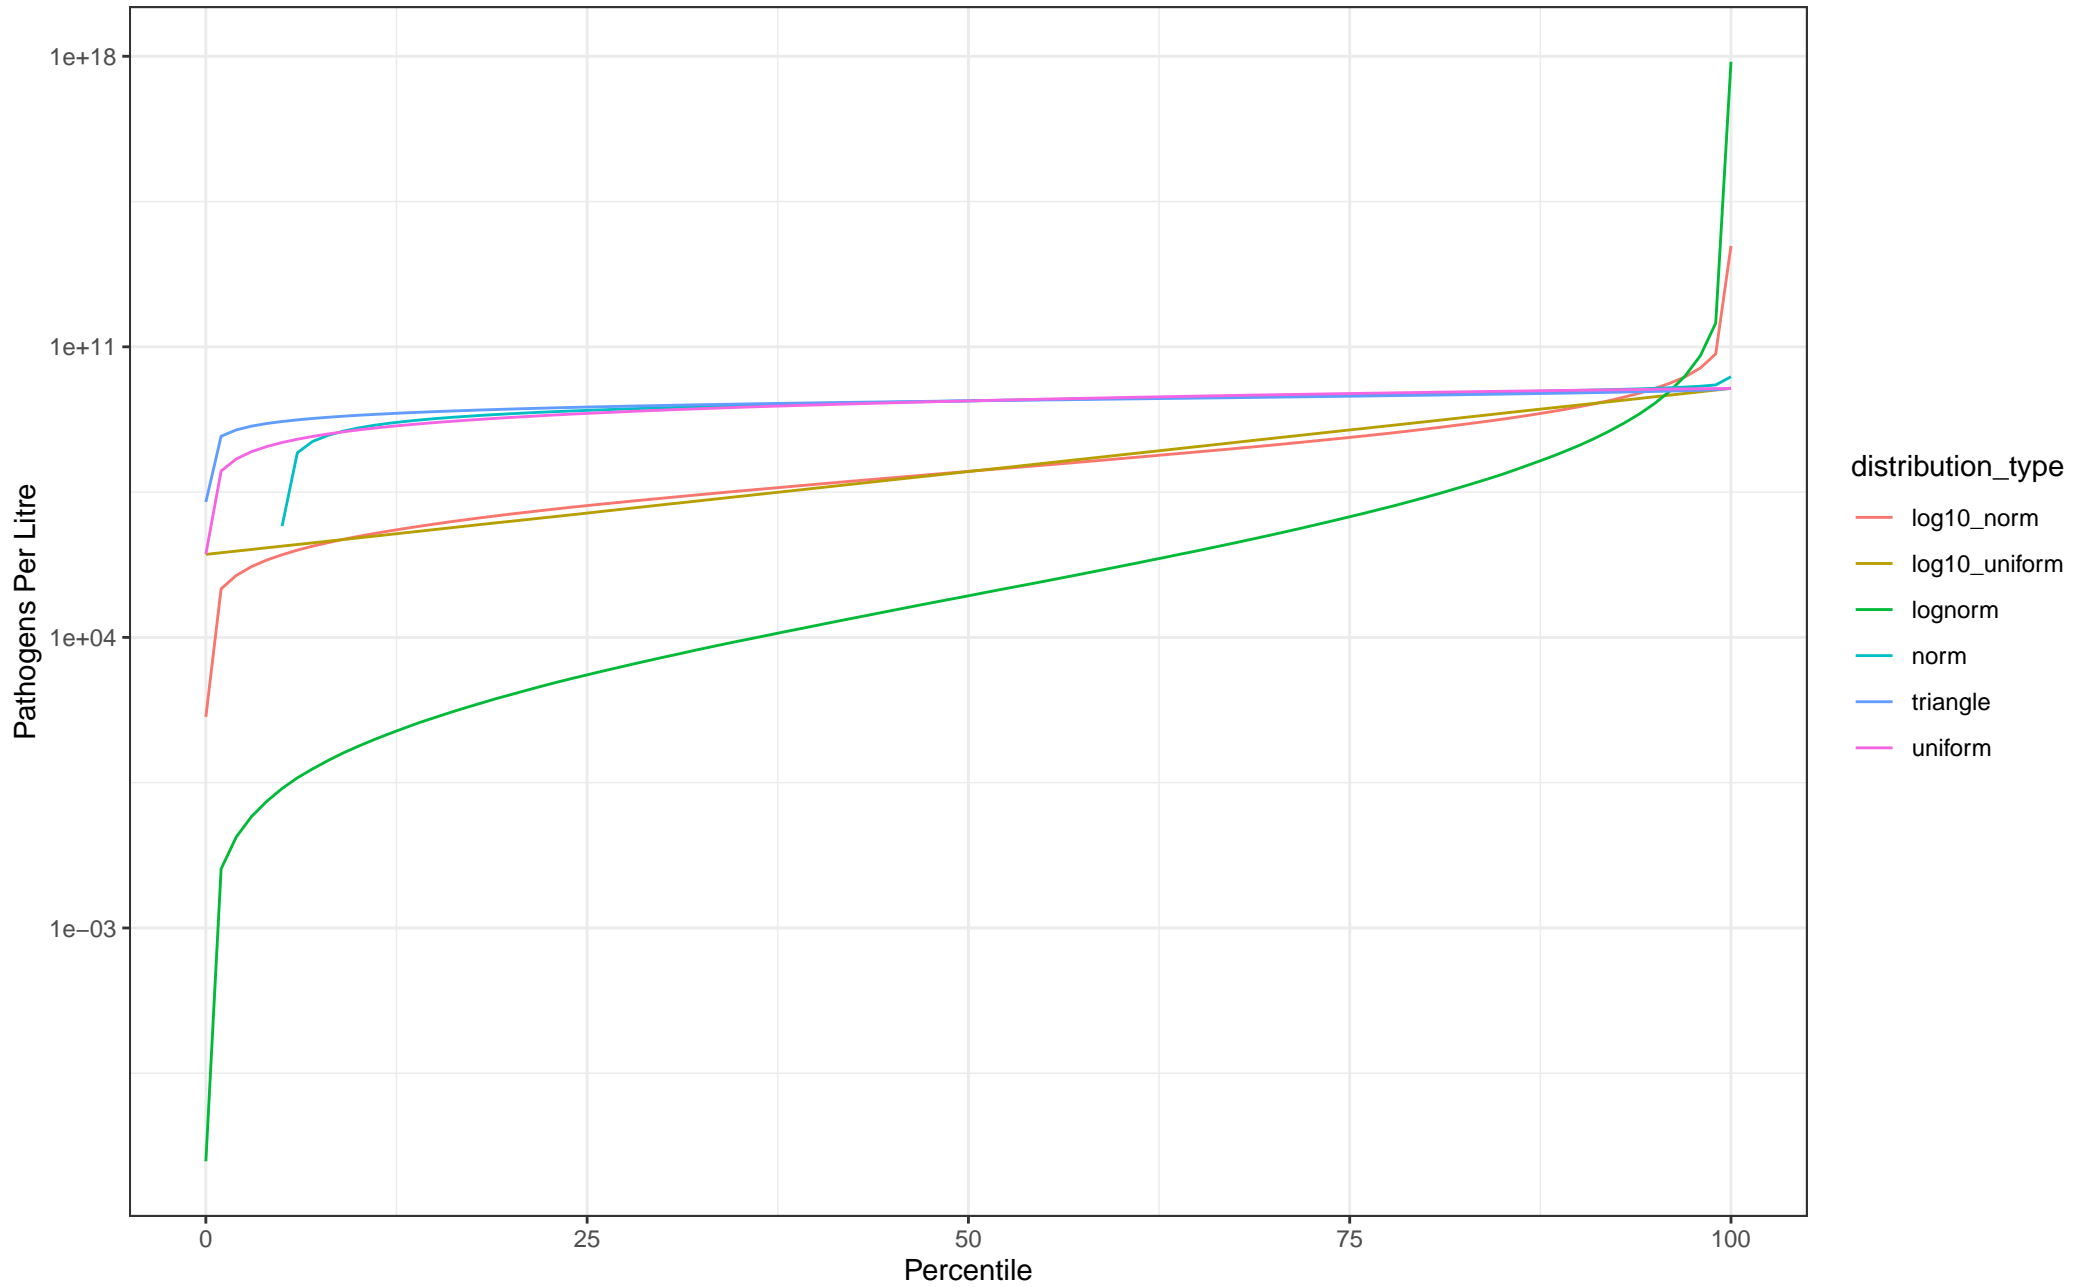


Vibrio cholerae (water source: sewage, raw):
min = 100.000000, max = 1000000.000000

Reference: [WHO (2011): Drinking water guideline, Table 7.6](http://apps.who.int/iris/bitstream/10665/44584/1/9789241548151_eng.pdf#page=159)

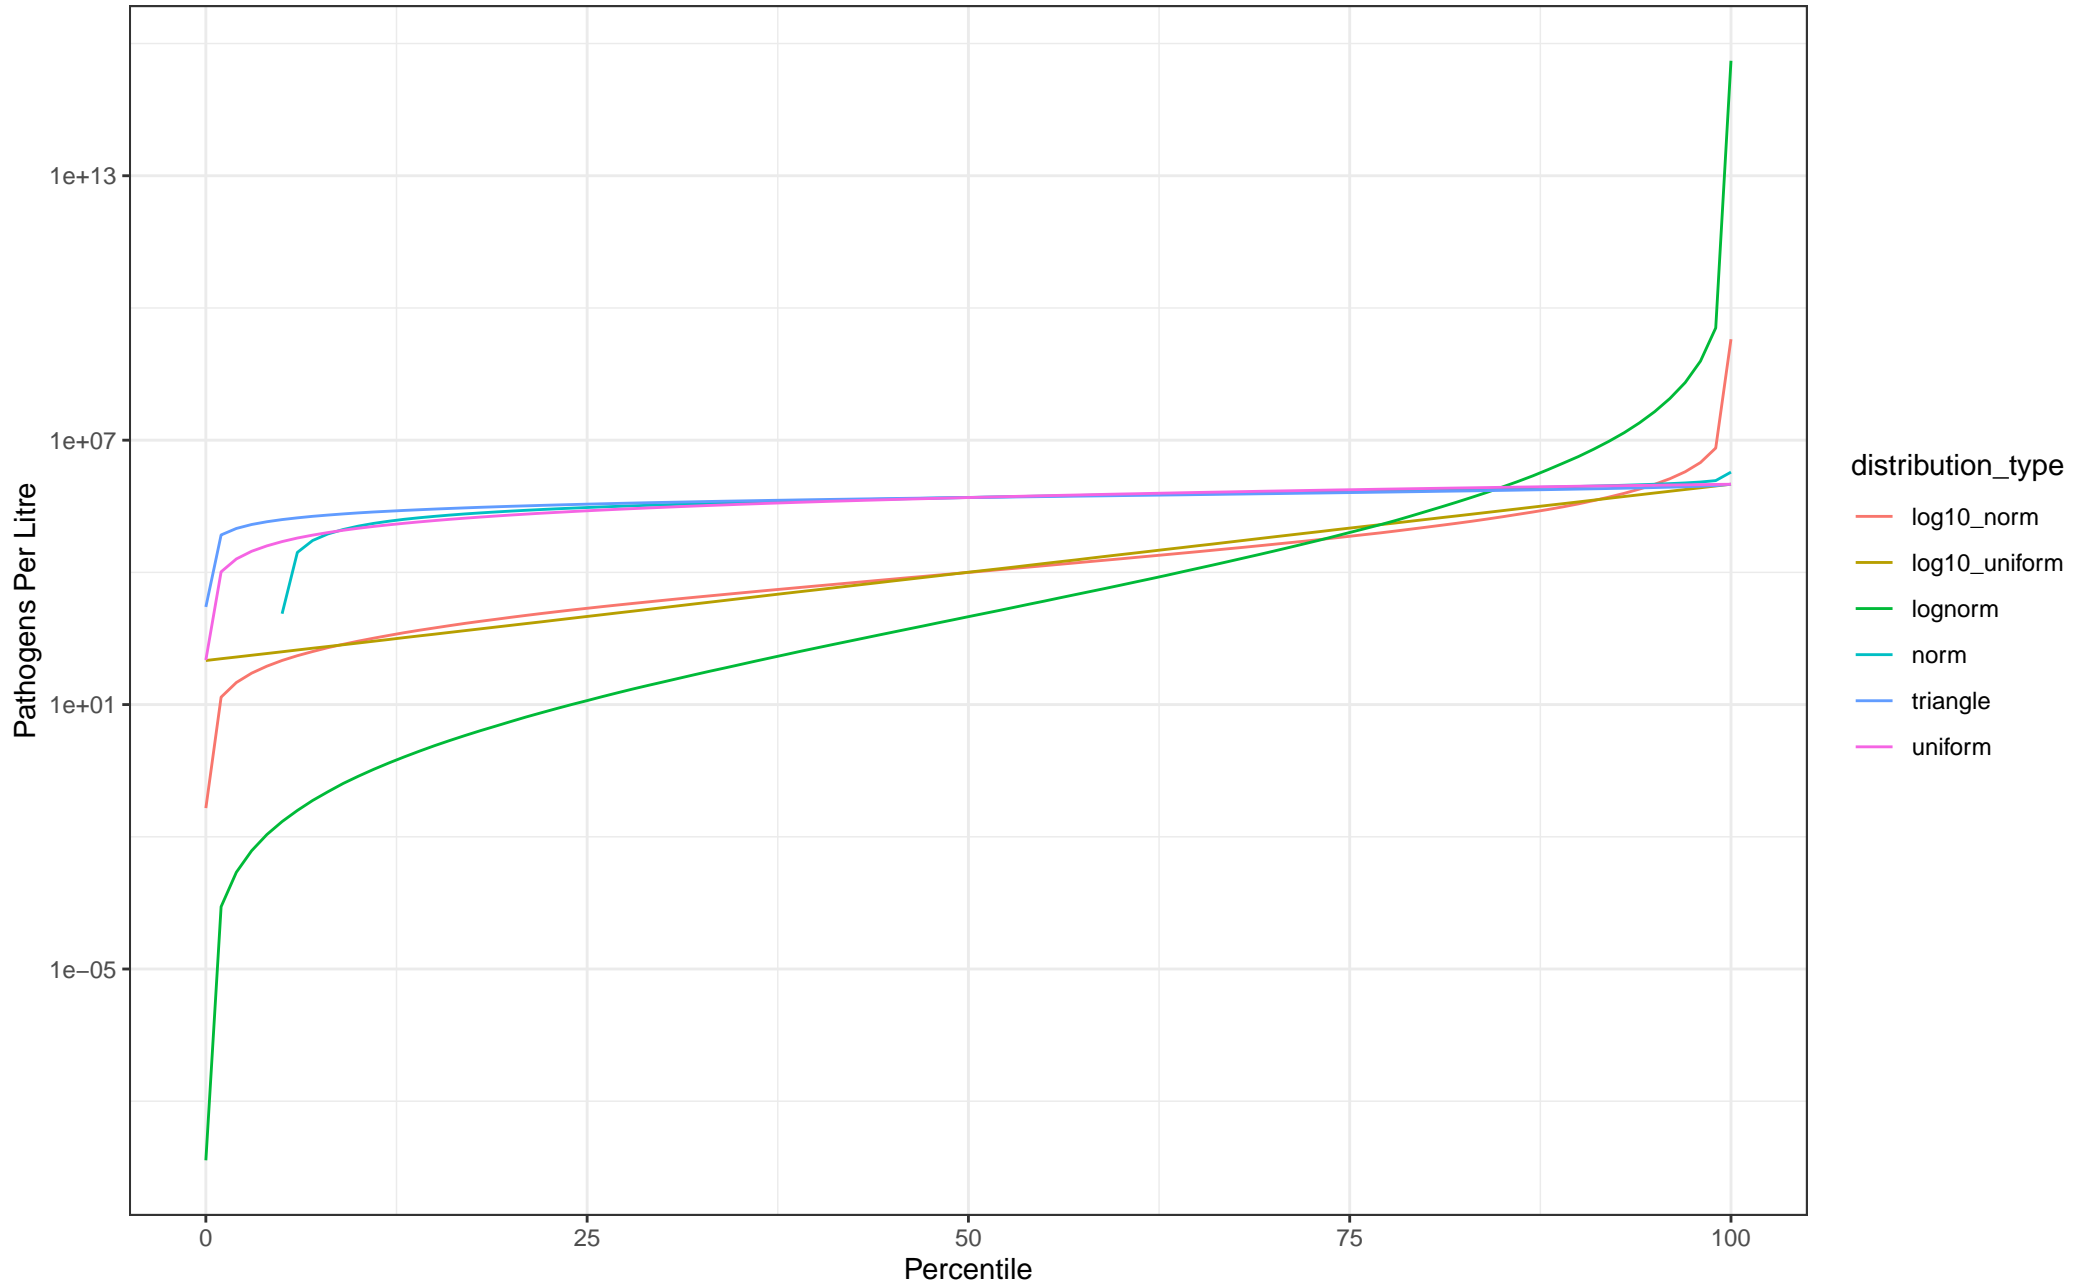


Cryptosporidium parvum (water source: sewage, raw):
min = 1.000000, max = 10000.000000

Reference: [WHO (2011): Drinking water guideline, Table 7.6](http://apps.who.int/iris/bitstream/10665/44584/1/9789241548151_eng.pdf#page=159)

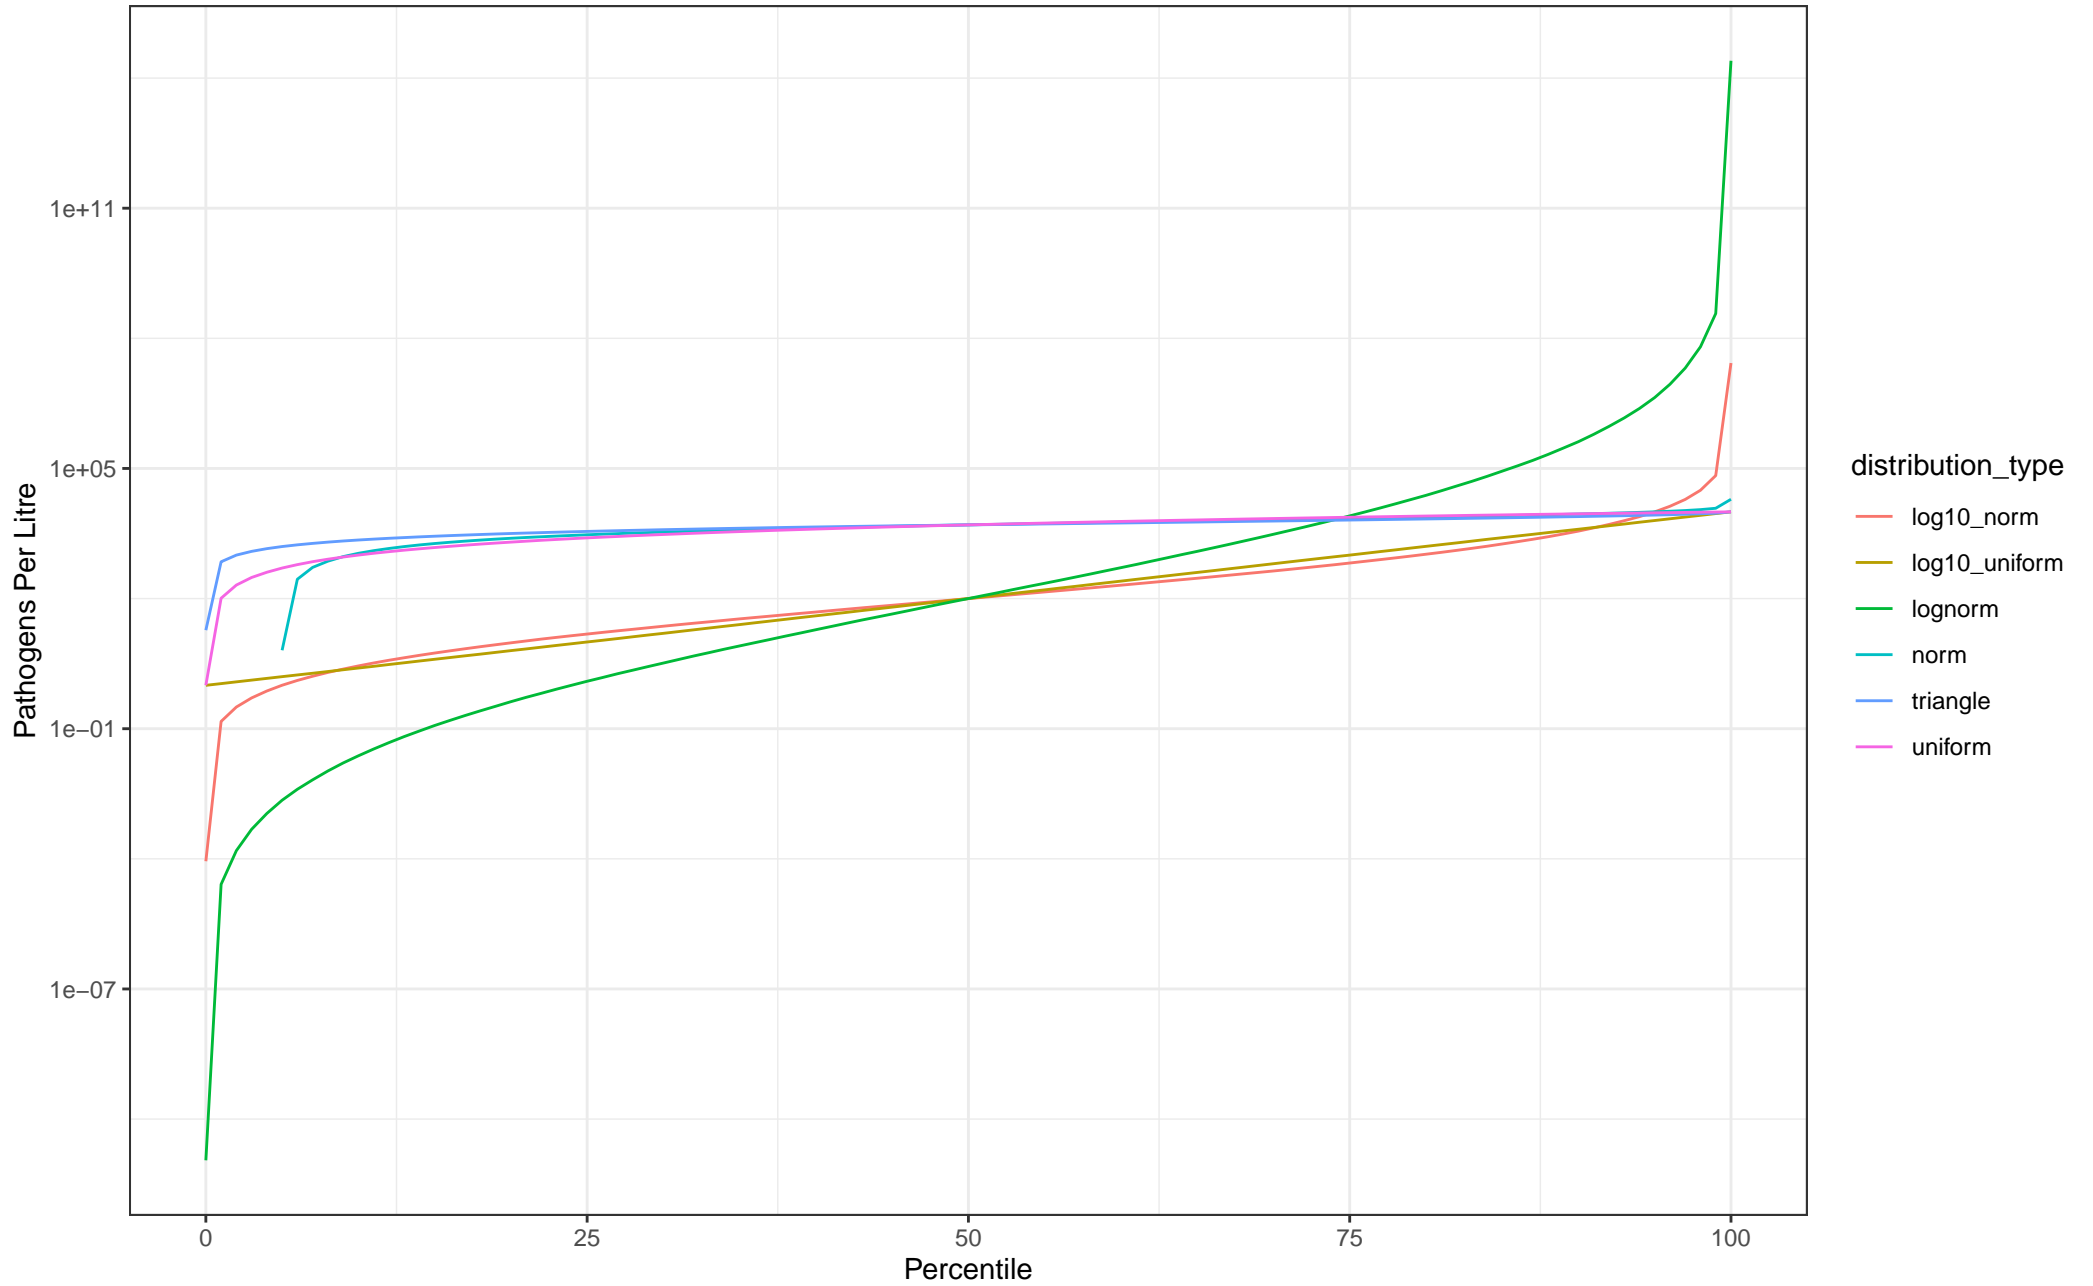


Giardia duodenalis (water source: sewage, raw):
min = 1.000000, max = 10000.000000

Reference: [WHO (2011): Drinking water guideline, Table 7.6](http://apps.who.int/iris/bitstream/10665/44584/1/9789241548151_eng.pdf#page=159)

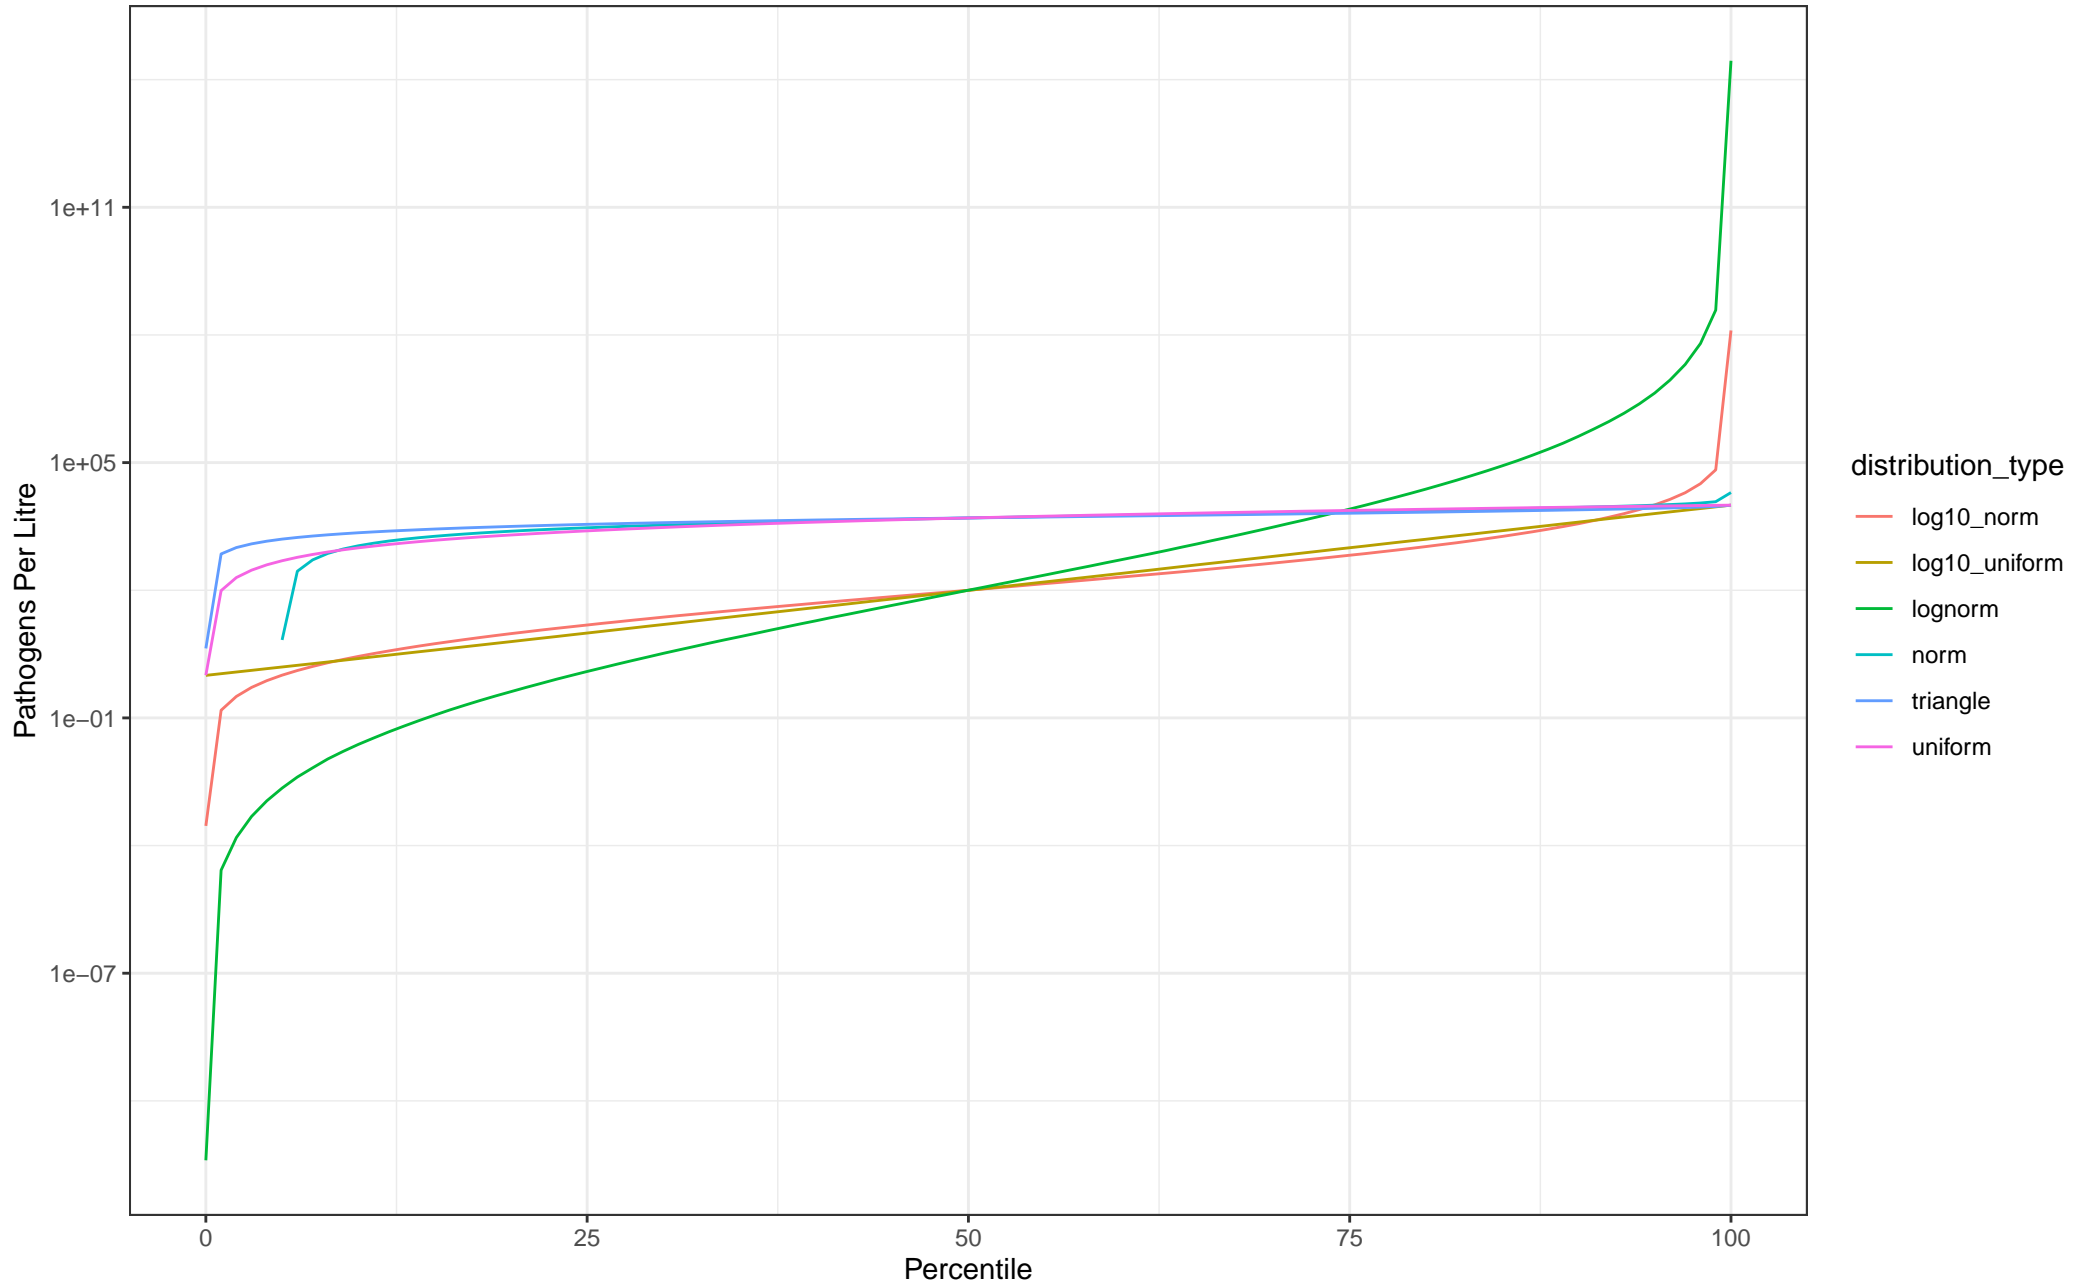


Enteroviruses (water source: sewage, raw):
min = 1.000000, max = 1000.000000

Reference: [WHO (2011): Drinking water guideline, Table 7.6](http://apps.who.int/iris/bitstream/10665/44584/1/9789241548151_eng.pdf#page=159)

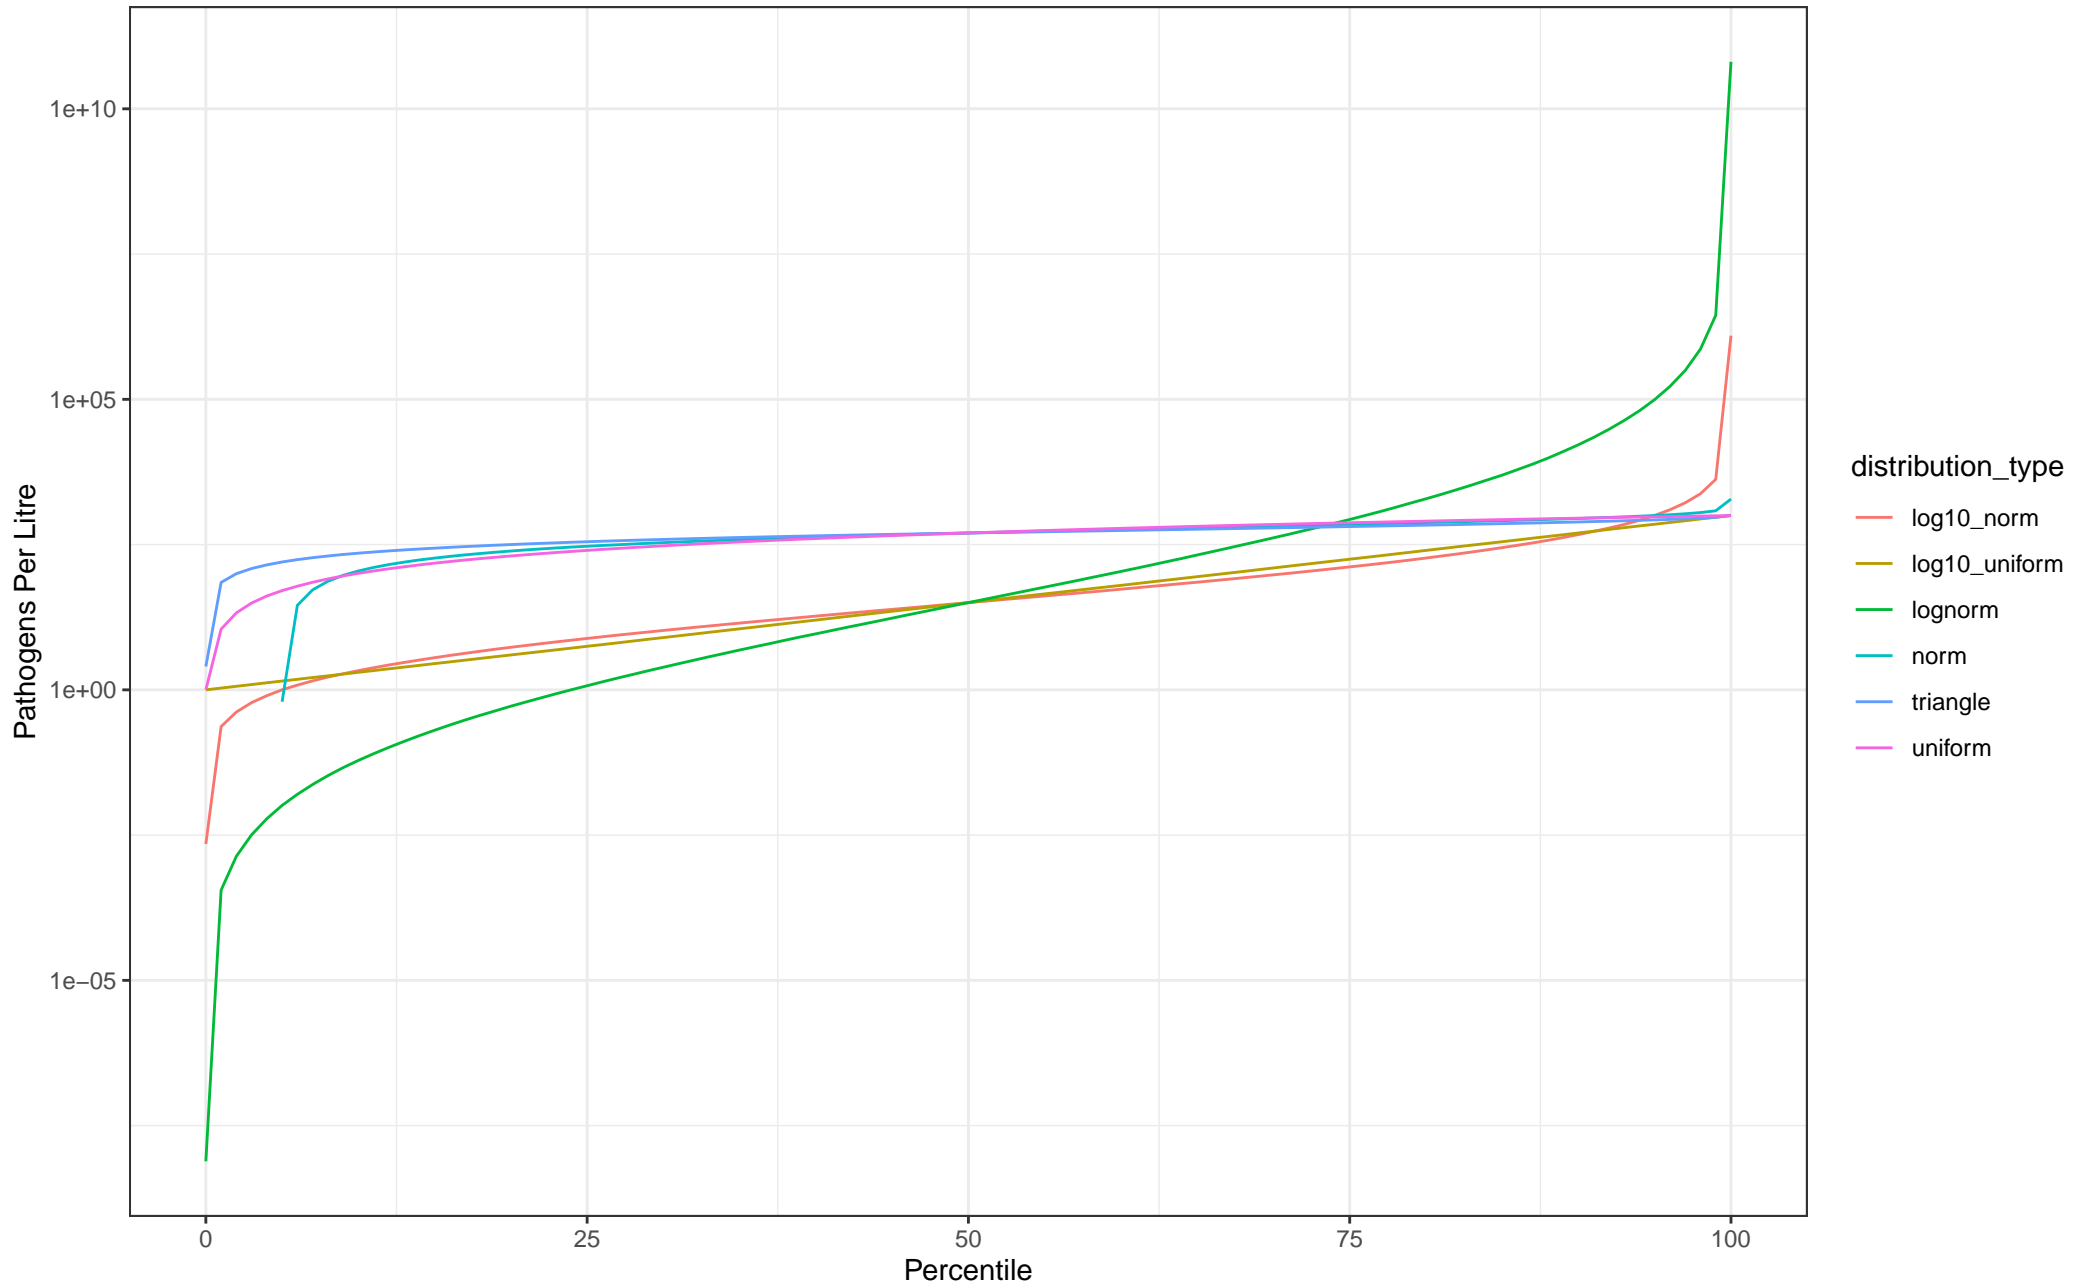


Rotavirus (water source: sewage, raw):
min = 50.000000, max = 5000.000000

Reference: [WHO (2011): Drinking water guideline, Table 7.6](http://apps.who.int/iris/bitstream/10665/44584/1/9789241548151_eng.pdf#page=159)

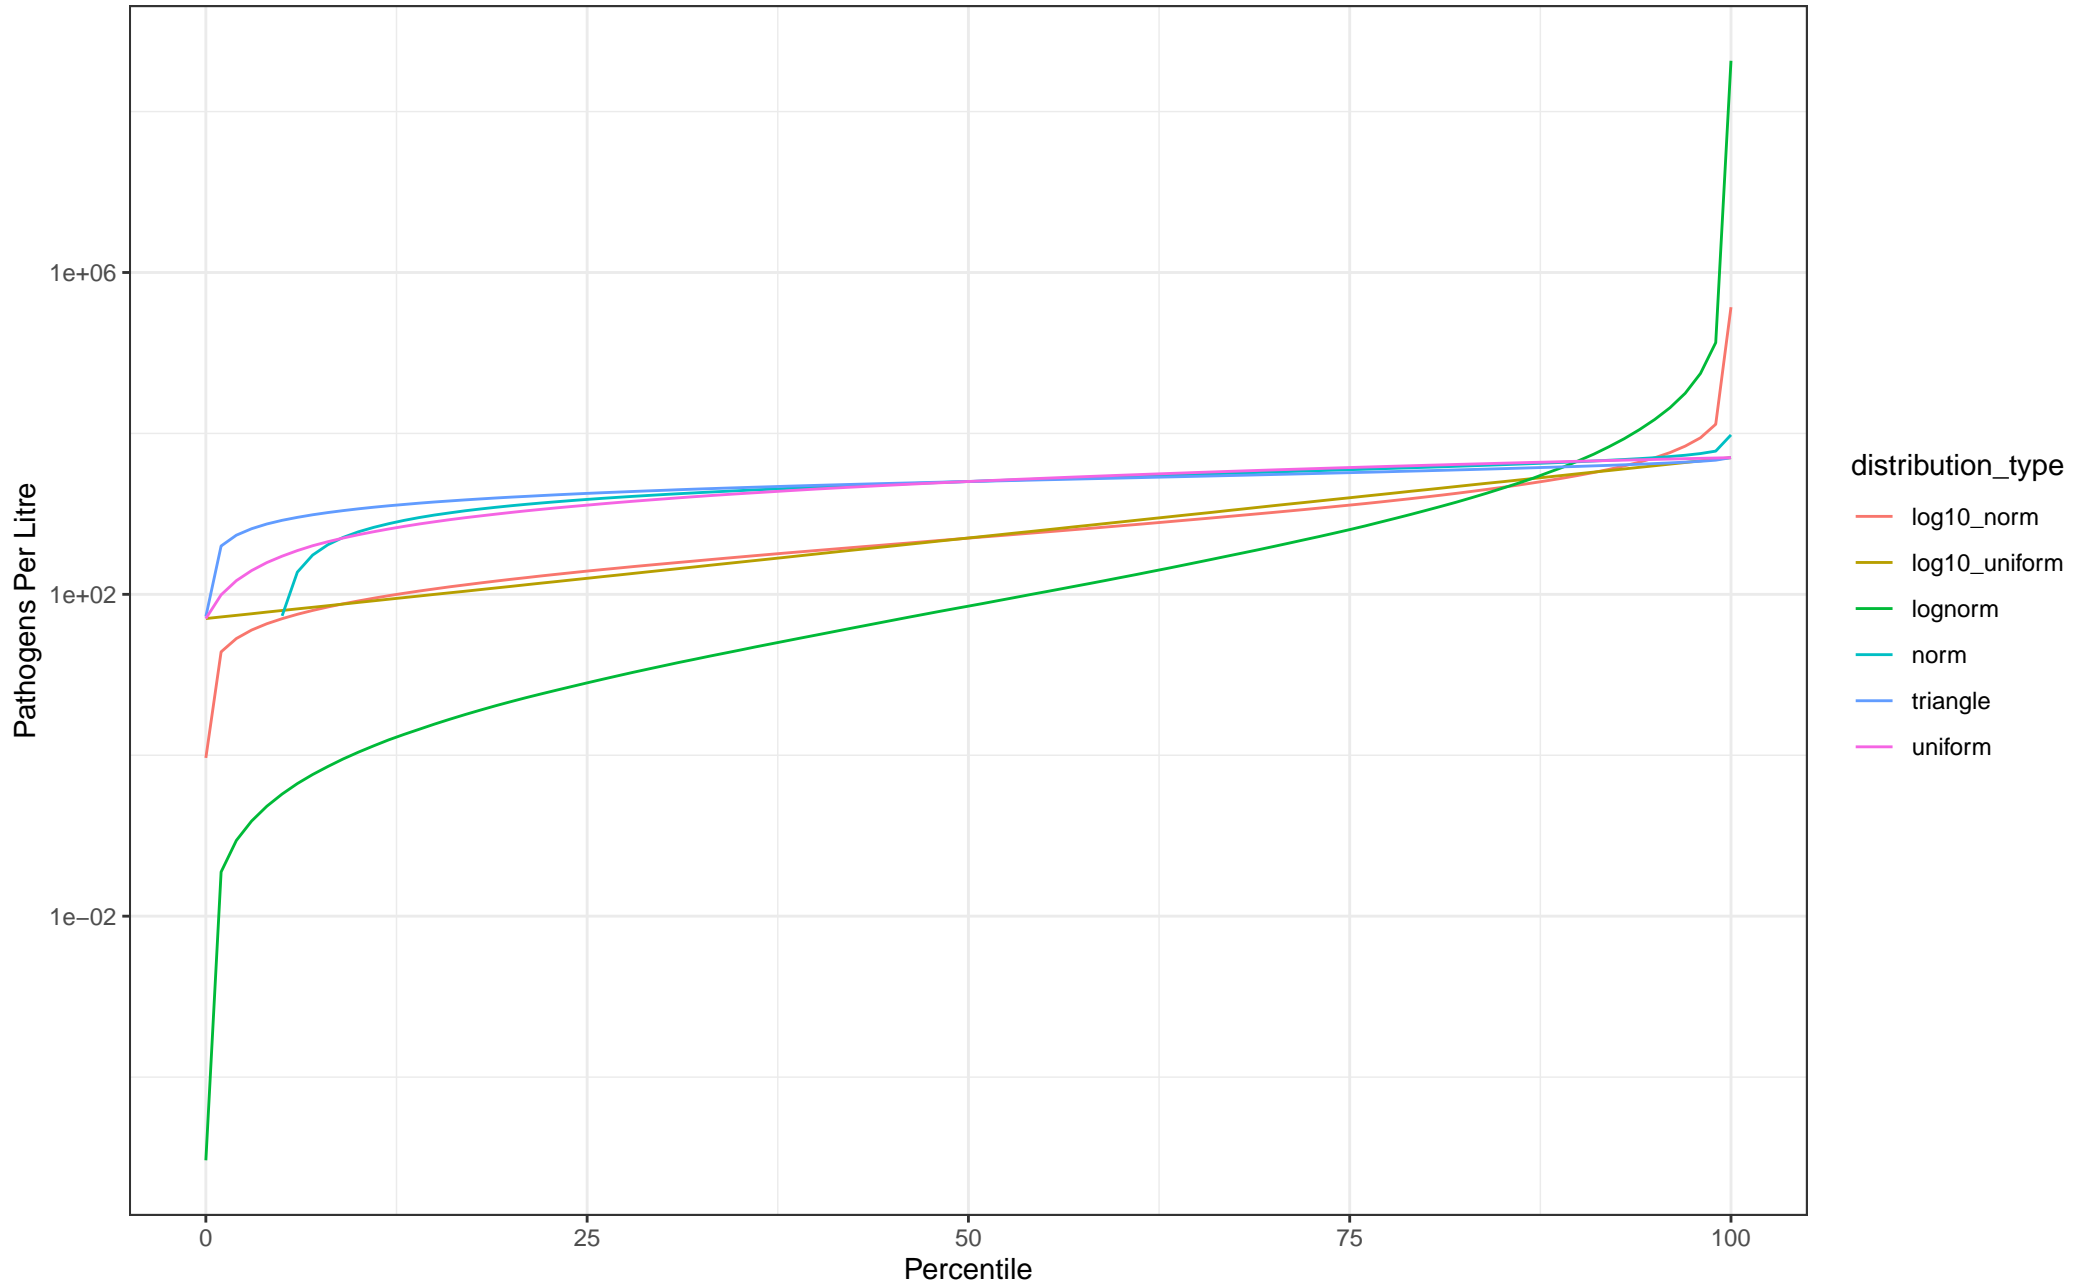


Campylobacter jejuni (water source: sewage, treated):
min = 0.001000, max = 1000.000000

Reference: [WHO (2006) safe use wastewater V2](http://www.who.int/water_sanitation_health/wastewater/wwuvol2intro.pdf)

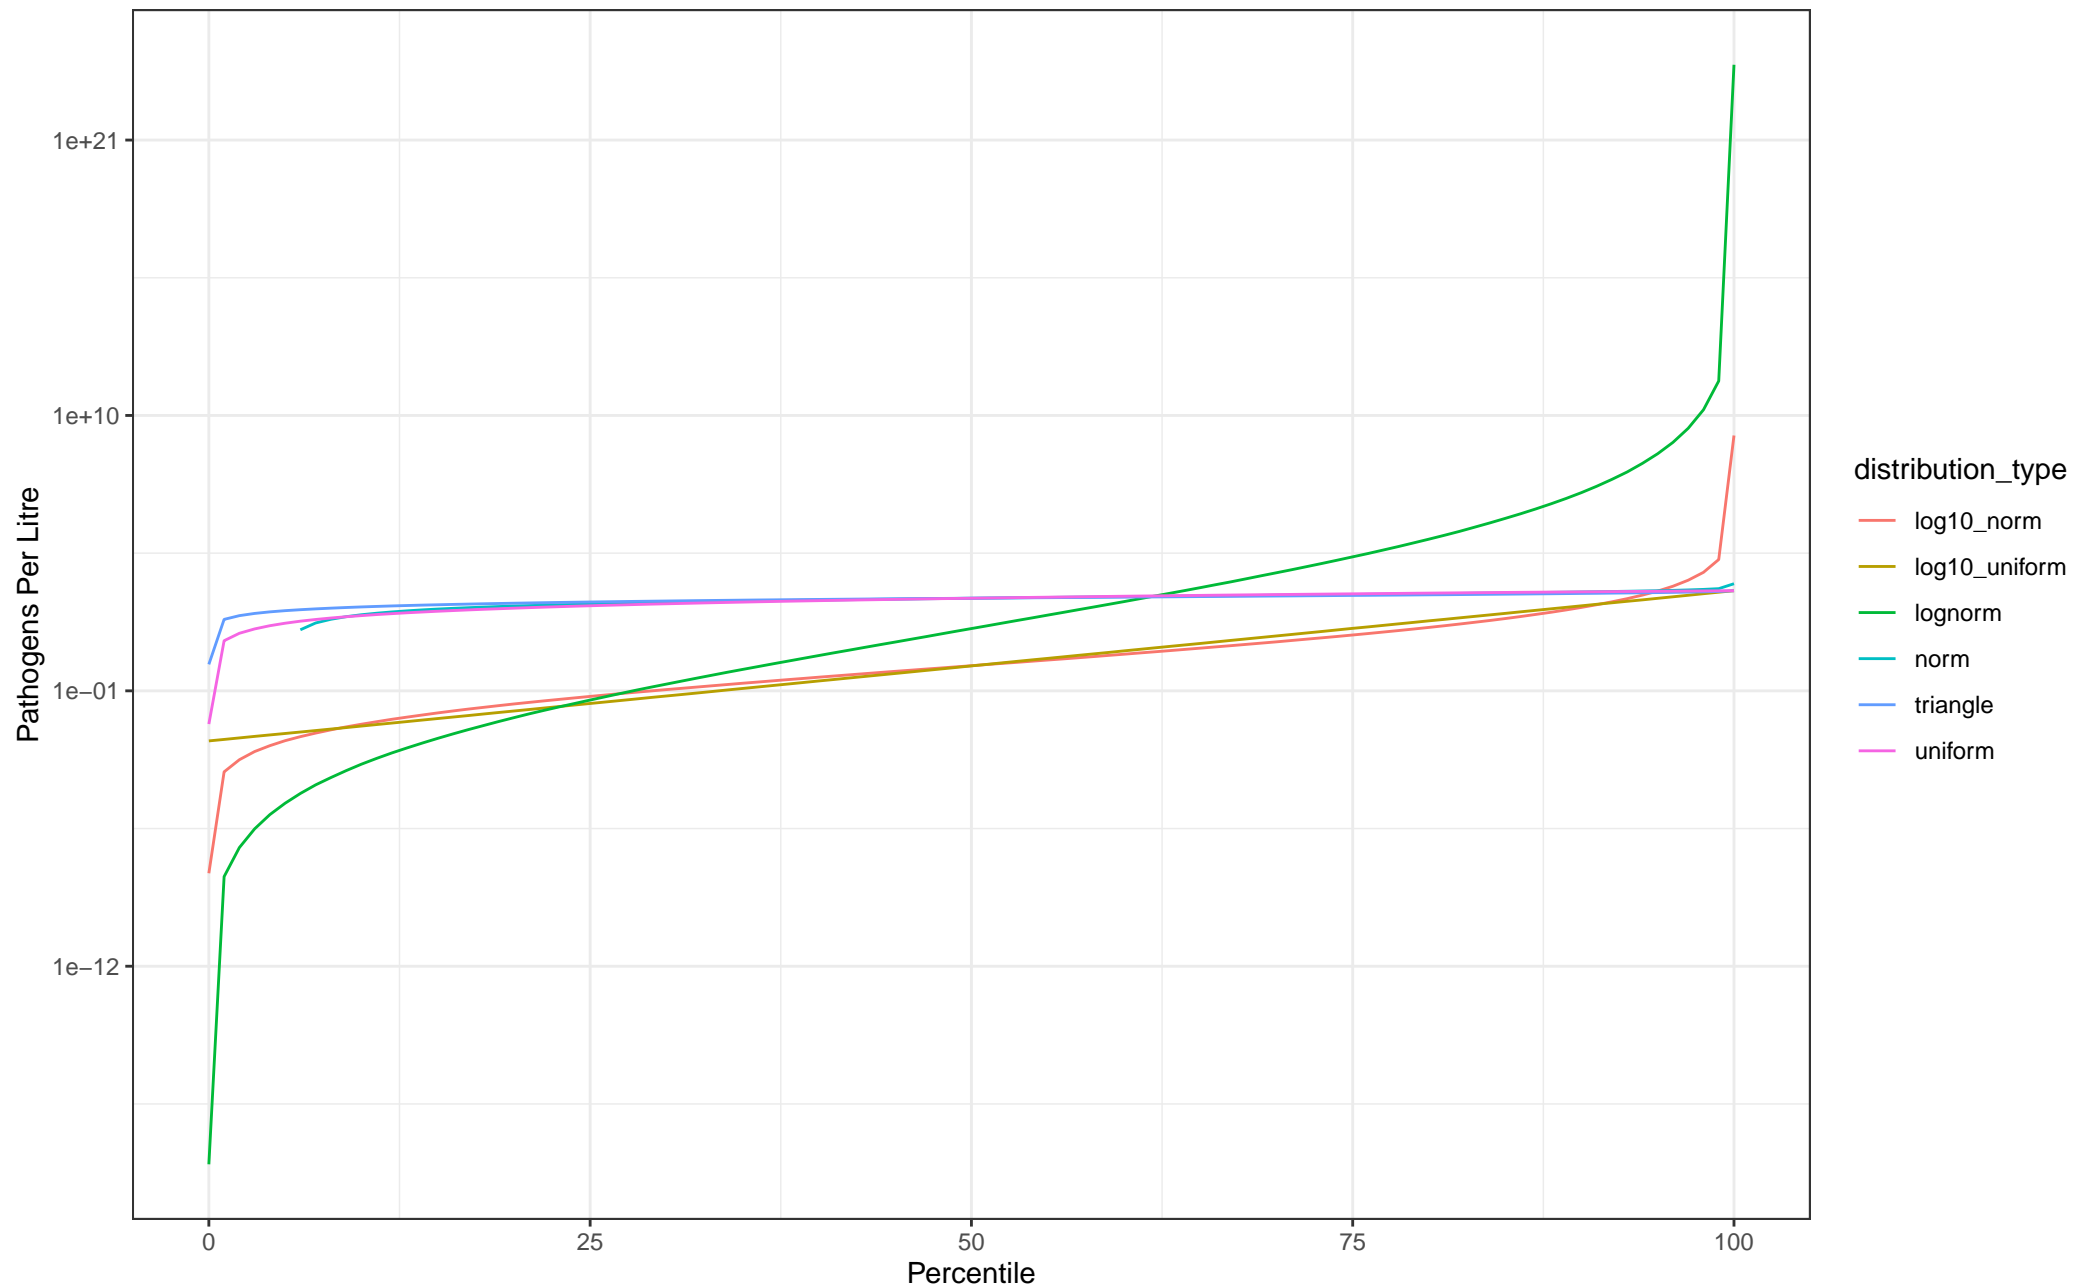


Cryptosporidium parvum (water source: sewage, treated):
min = 0.010000, max = 10000.000000

Reference: [WHO (2006) safe use wastewater V2](http://www.who.int/water_sanitation_health/wastewater/wwuvol2intro.pdf)

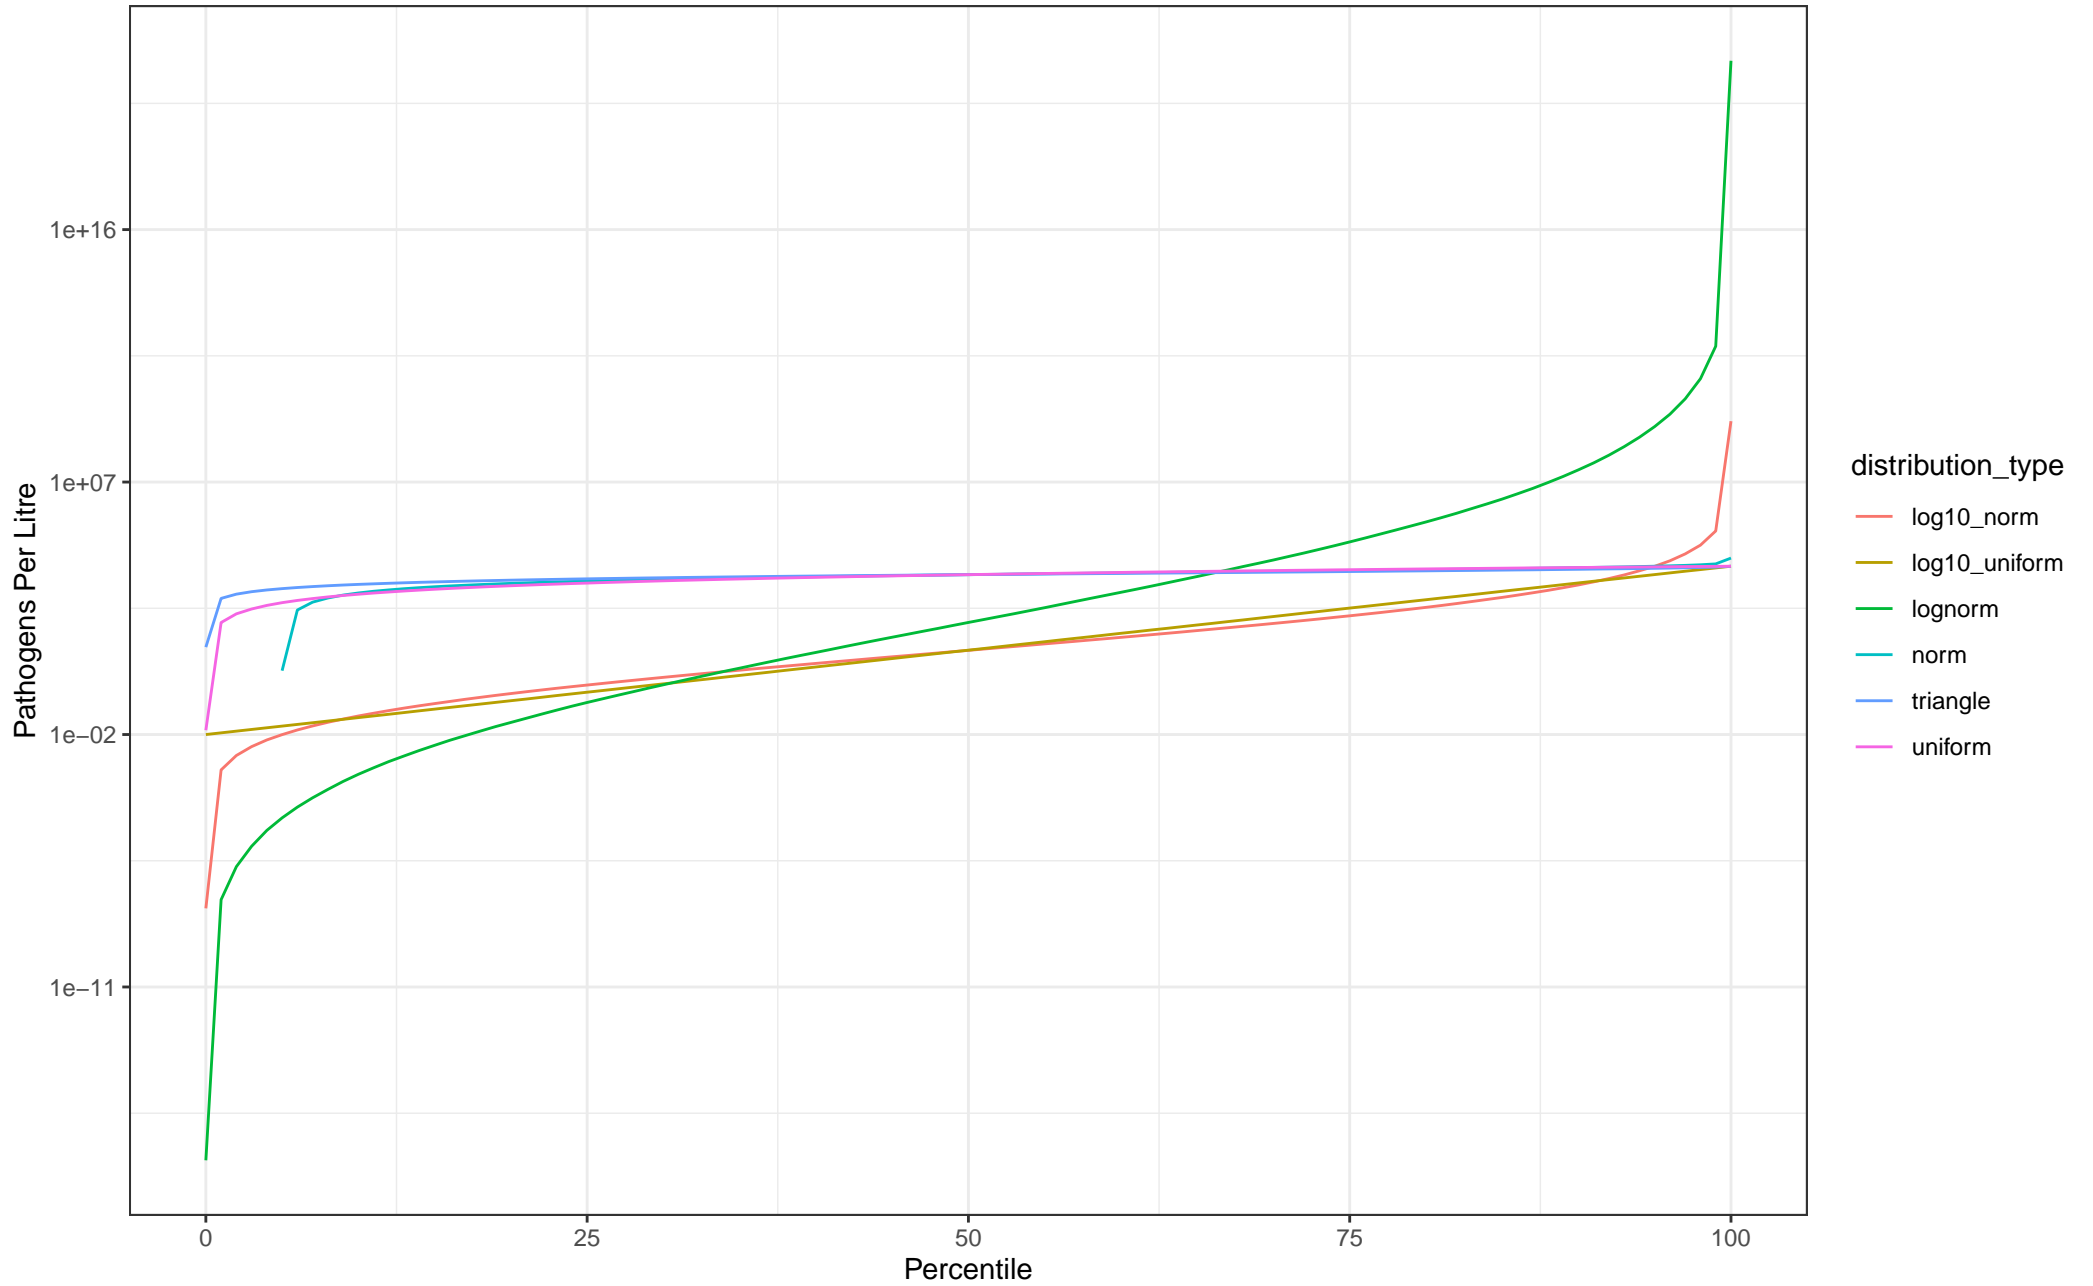

Rotavirus (water source: sewage, treated):
min = 0.100000, max = 1000.000000


Reference: [WHO (2006) safe use wastewater V2](http://www.who.int/water_sanitation_health/wastewater/wwuvol2intro.pdf)

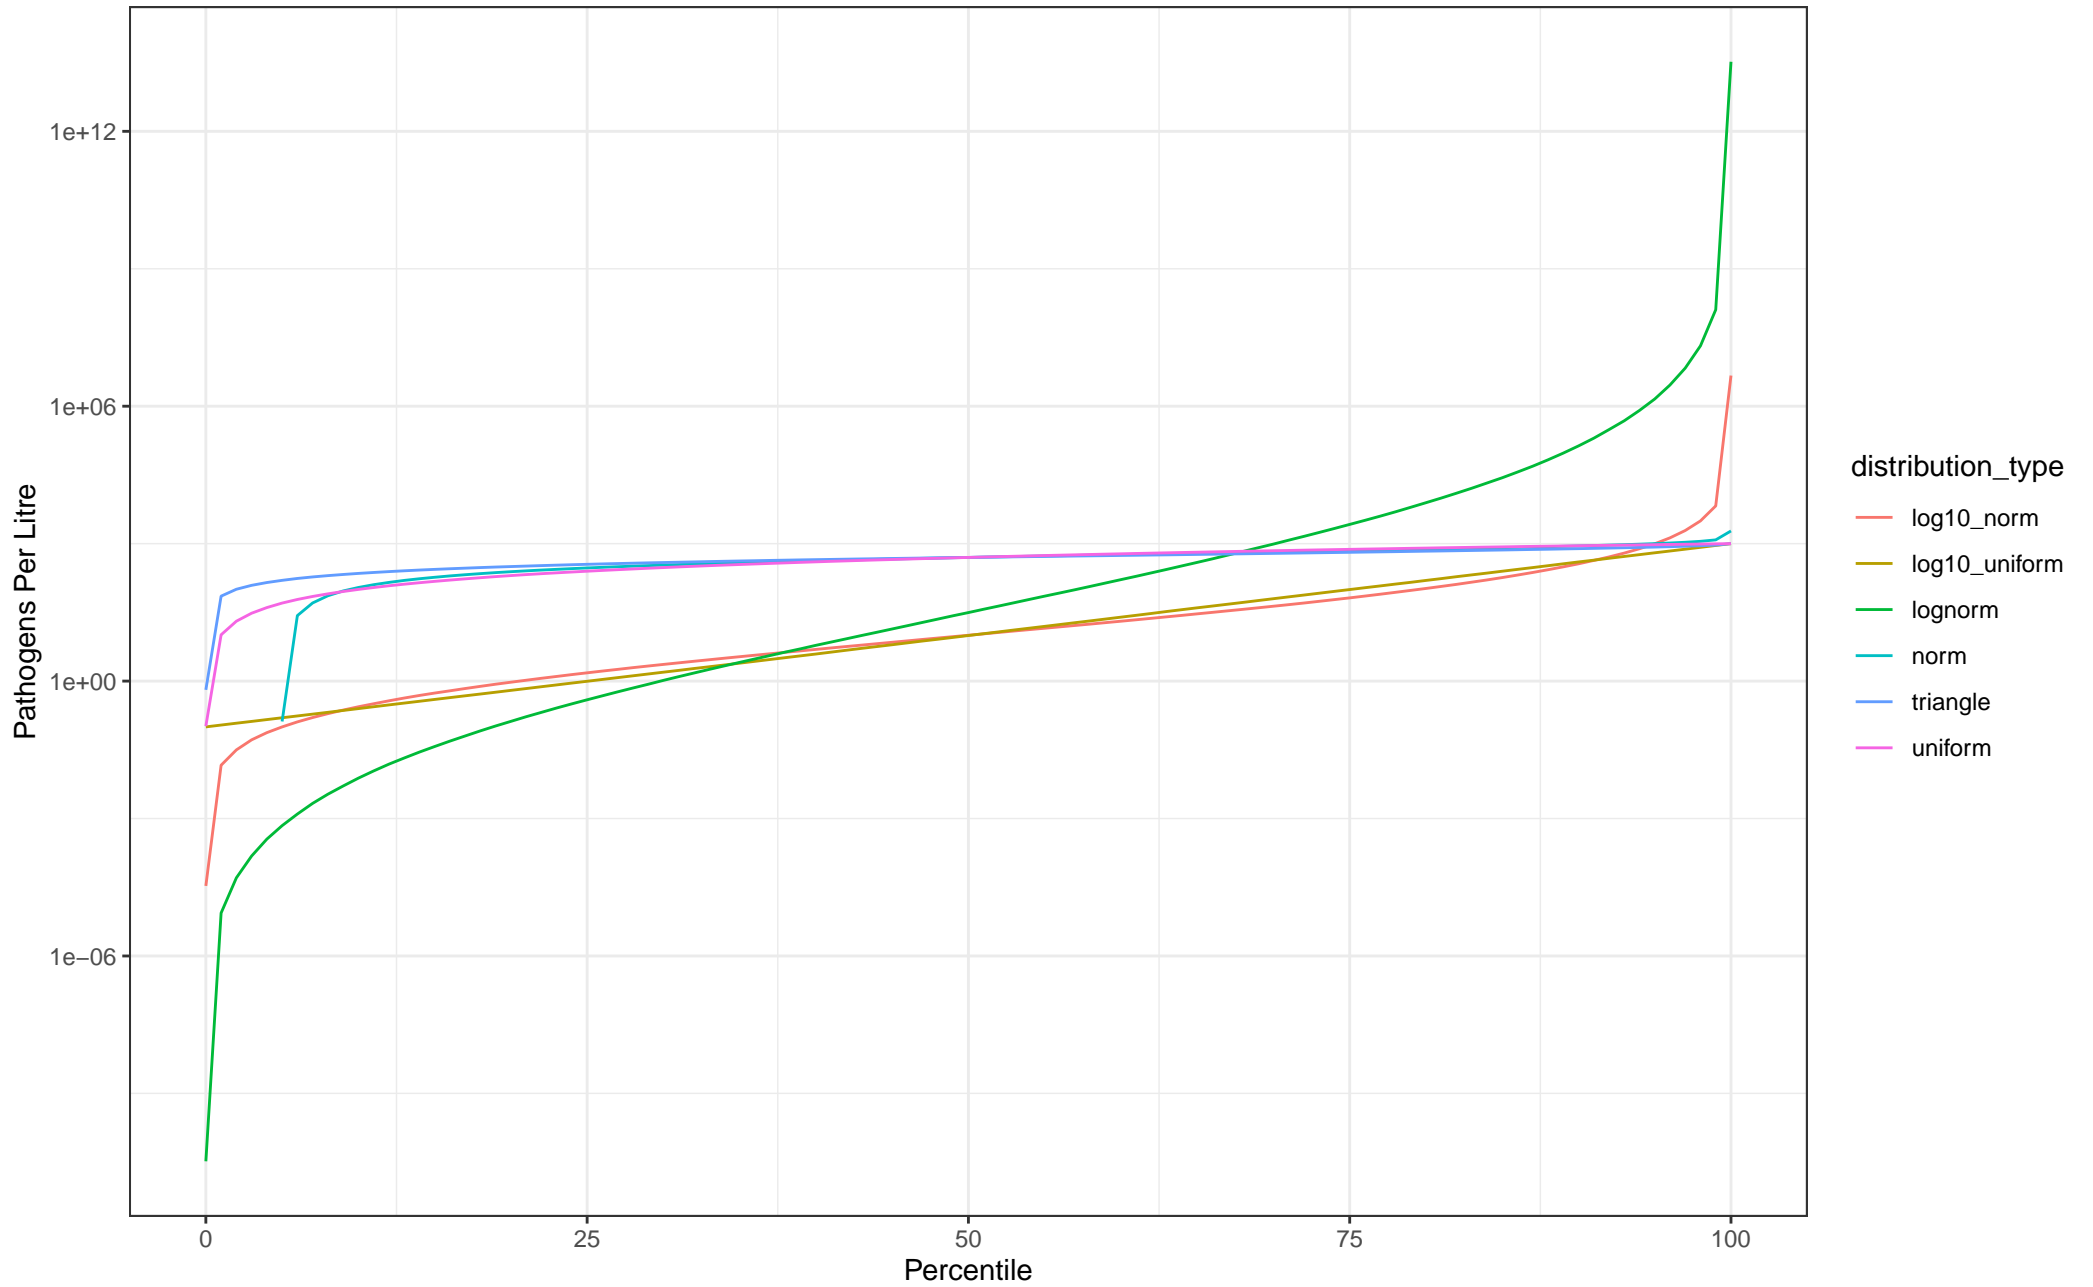

Campylobacter jejuni (water source: surface water, contaminated):

min = 90.000000, max = 2500.000000


Reference: [WHO GDWQ (2004)](http://www.who.int/water_sanitation_health/dwq/GDWQ2004web.pdf)

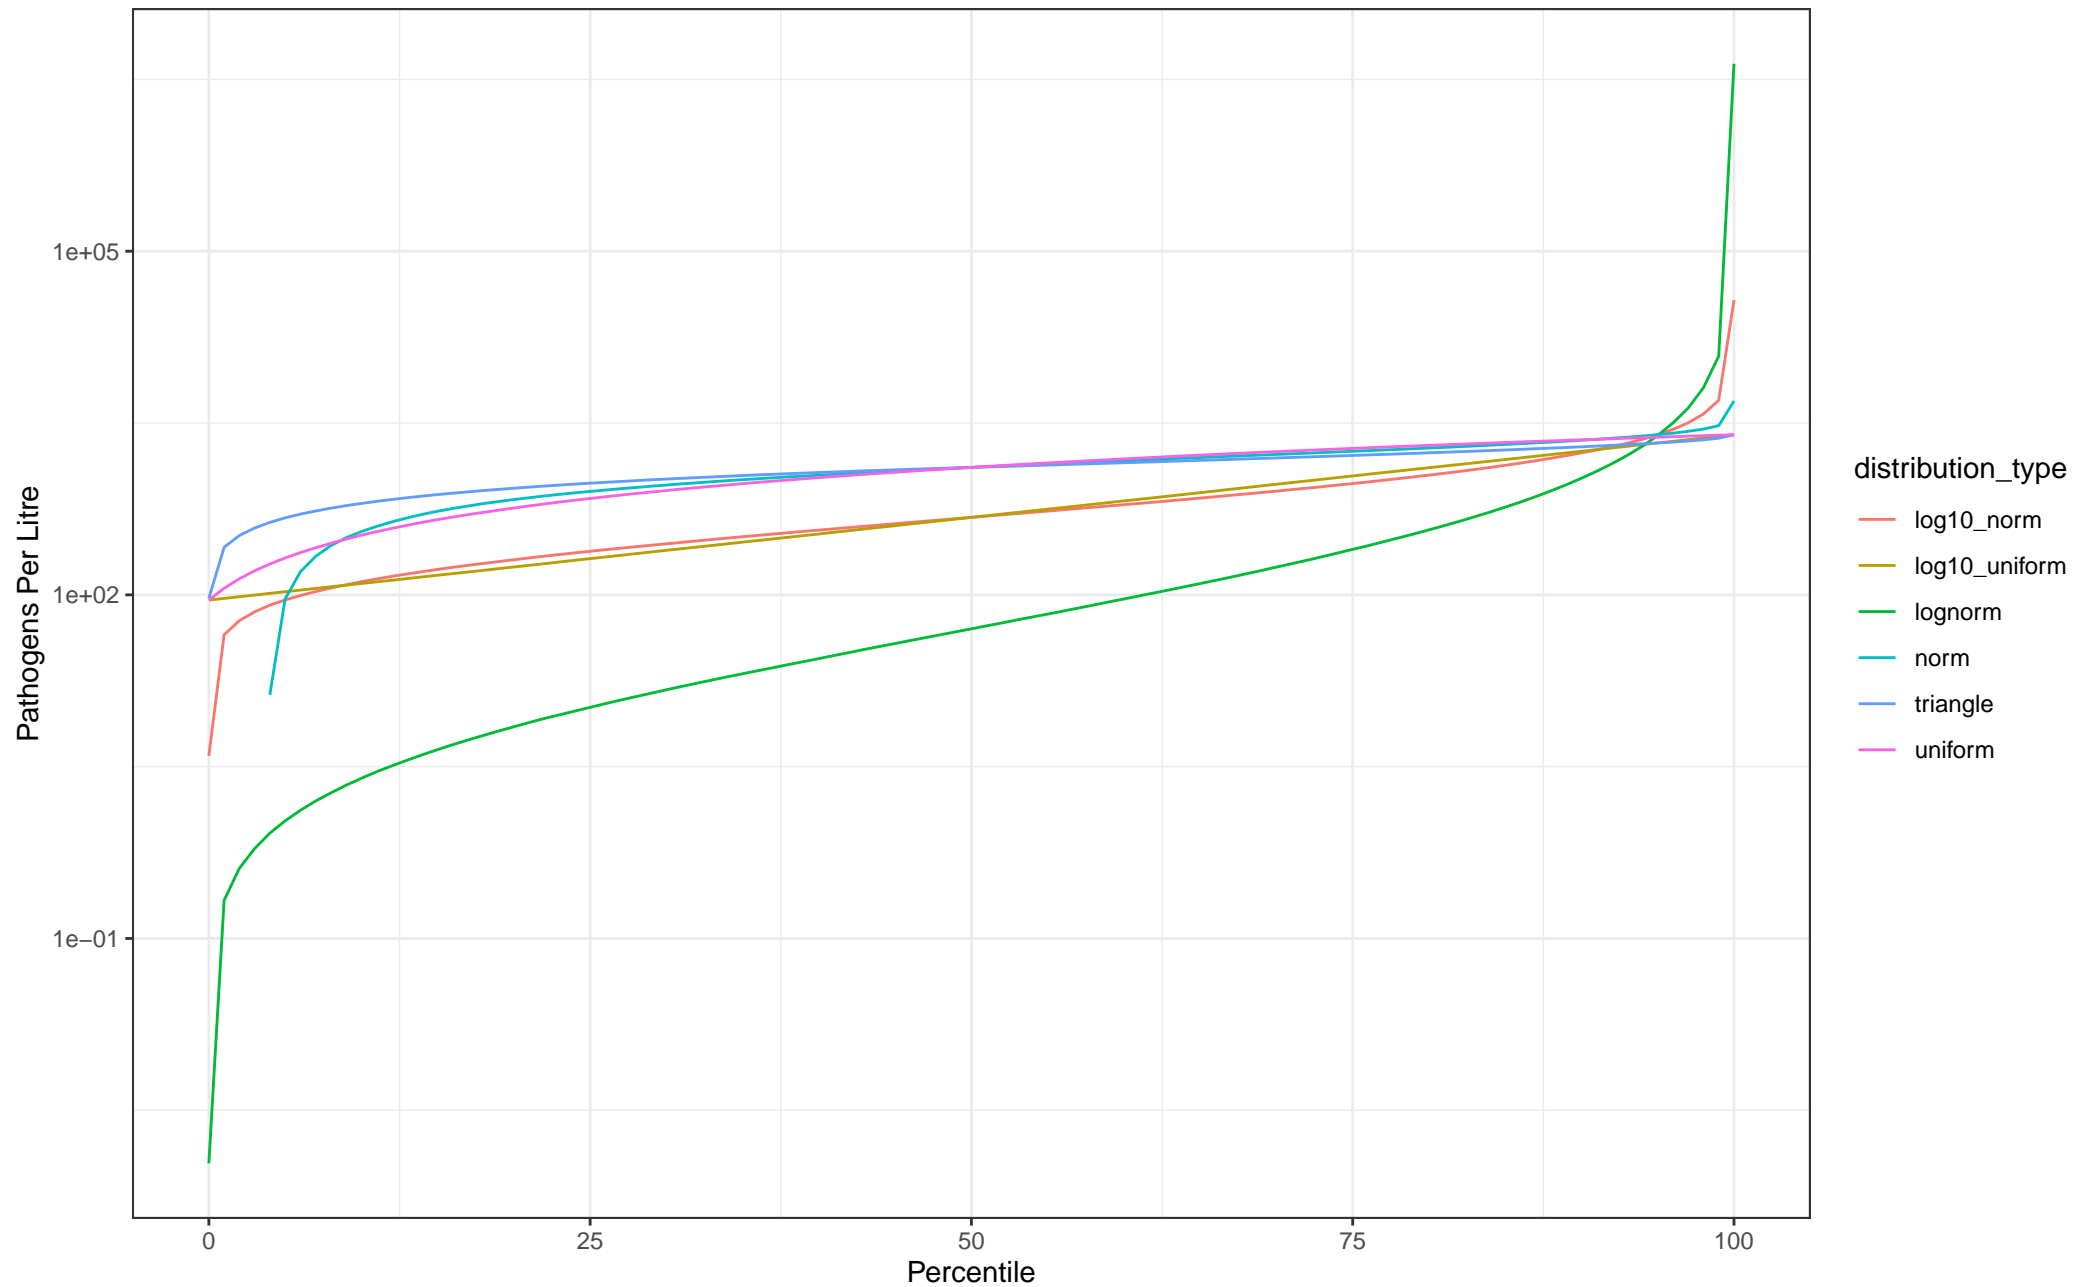

Cryptosporidium parvum (water source: surface water, contaminated):

min = 2.000000, max = 480.000000


Reference: [WHO GDWQ (2004)](http://www.who.int/water_sanitation_health/dwq/GDWQ2004web.pdf)

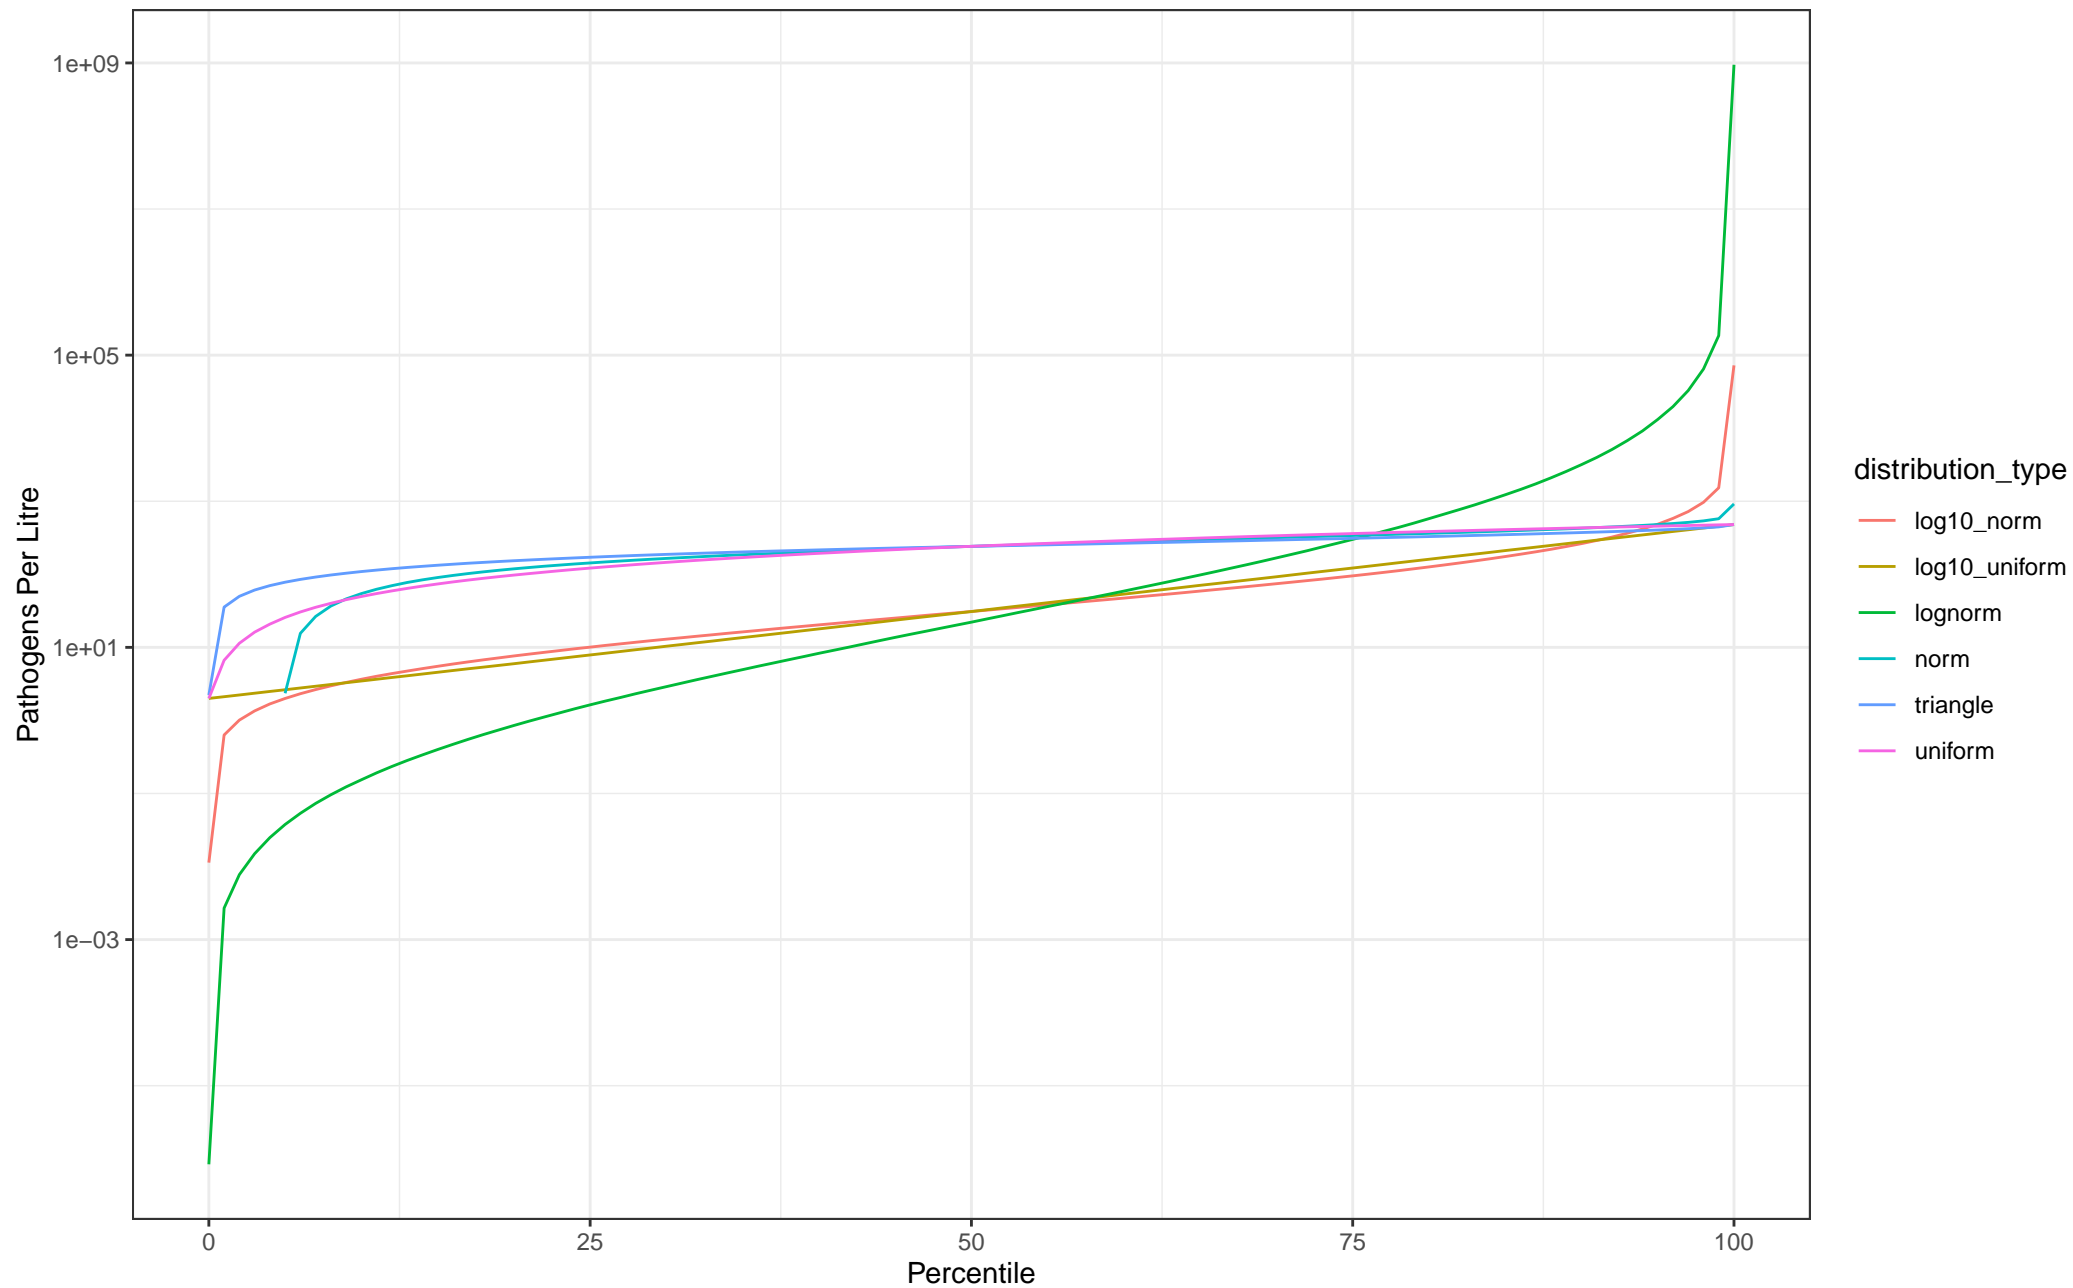

Rotavirus (water source: surface water, contaminated):


min = 30.000000, max = 60.000000

Reference: [WHO GDWQ (2004)](http://www.who.int/water_sanitation_health/dwq/GDWQ2004web.pdf)

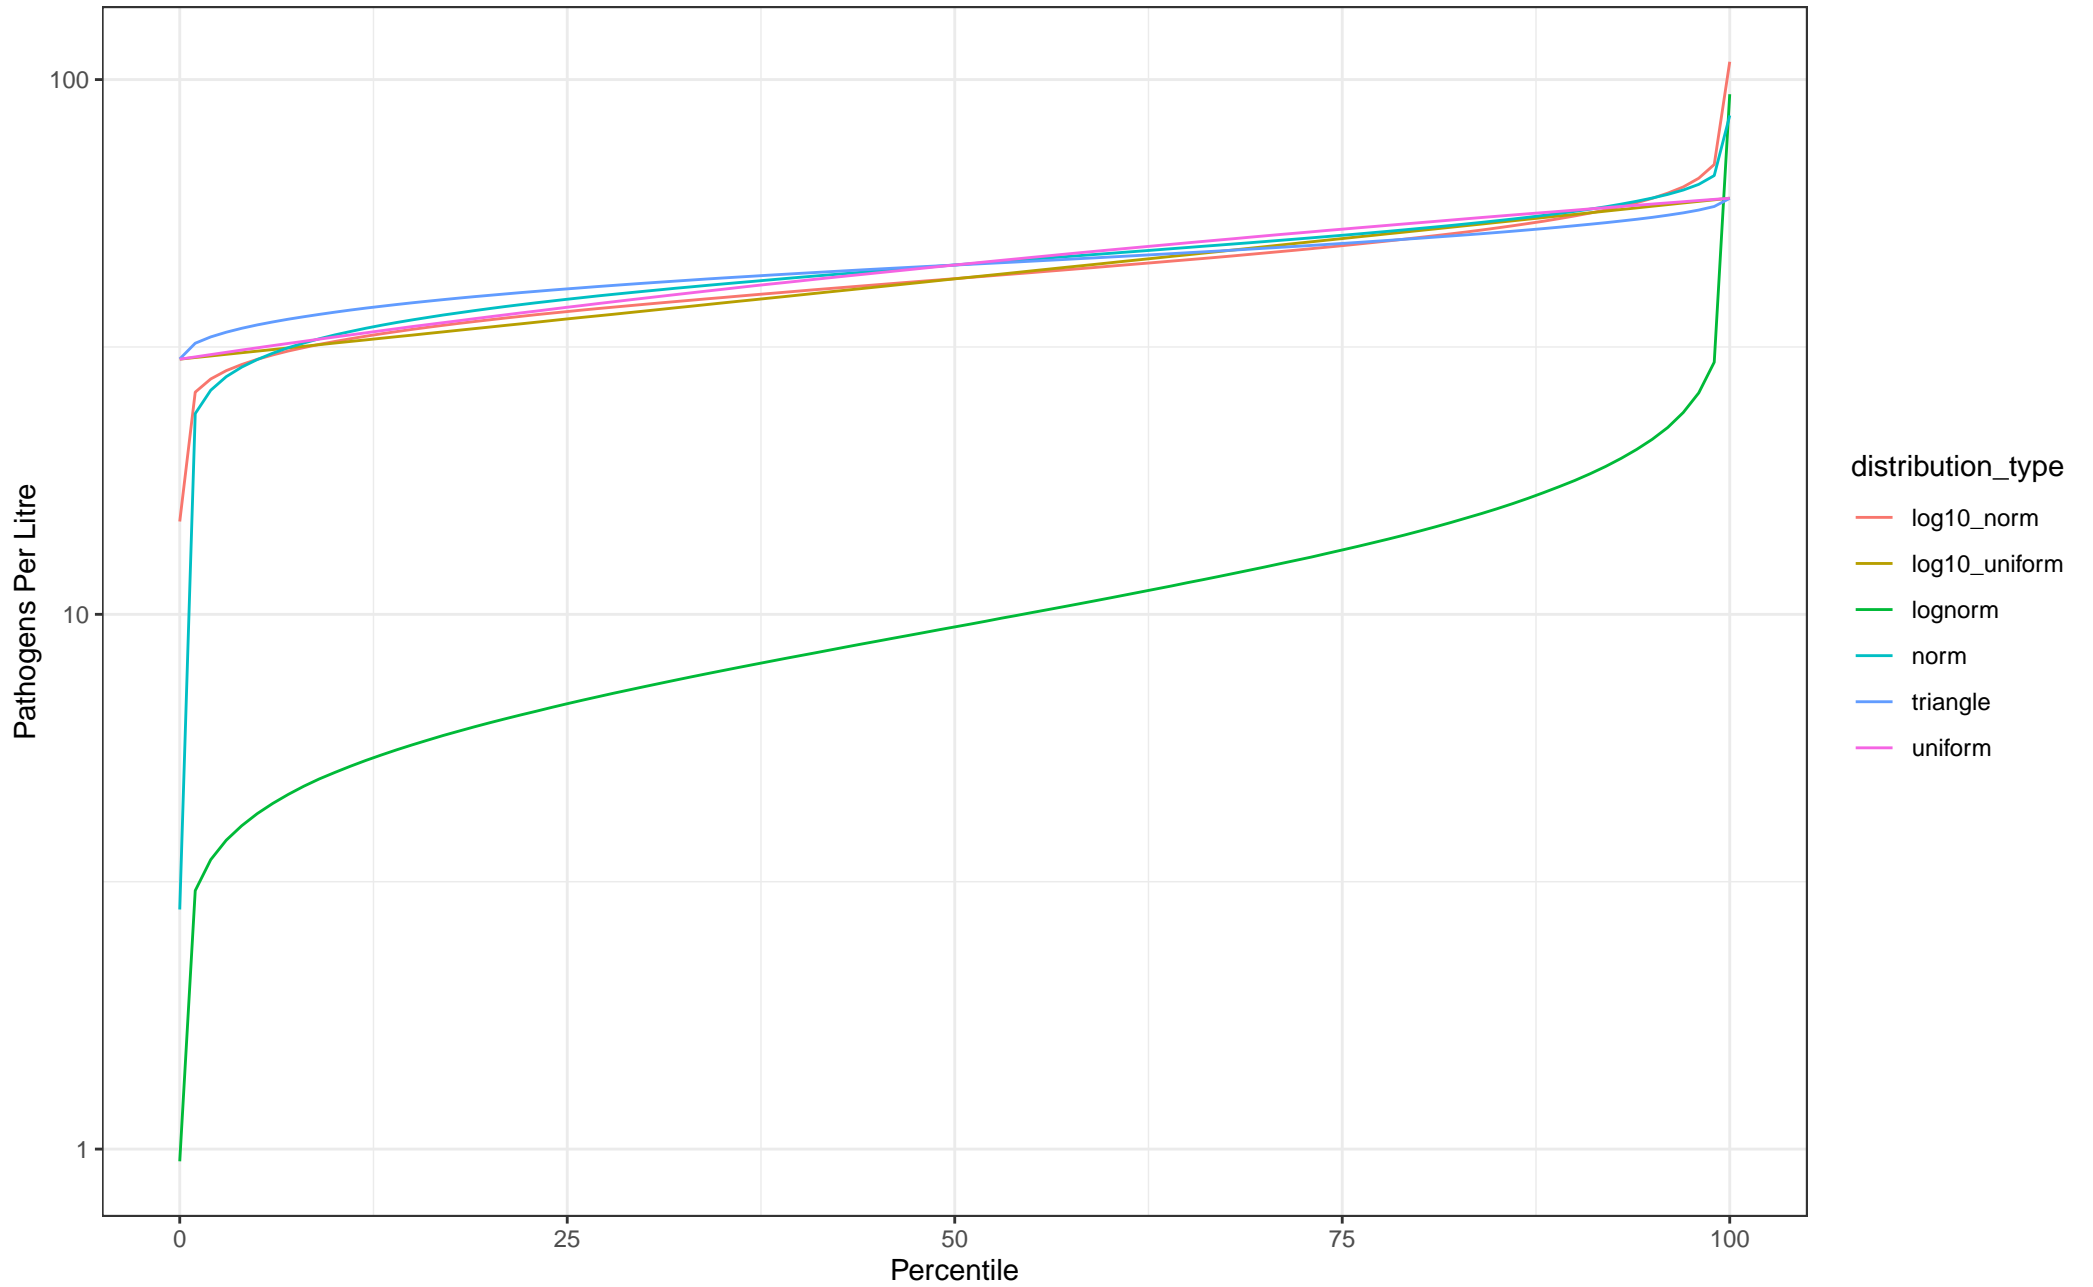


Campylobacter jejuni (water source: surface water, general):
min = 100.000000, max = 10000.000000

Reference: [WHO (2011): Drinking water guideline, Table 7.6](http://apps.who.int/iris/bitstream/10665/44584/1/9789241548151_eng.pdf#page=159)

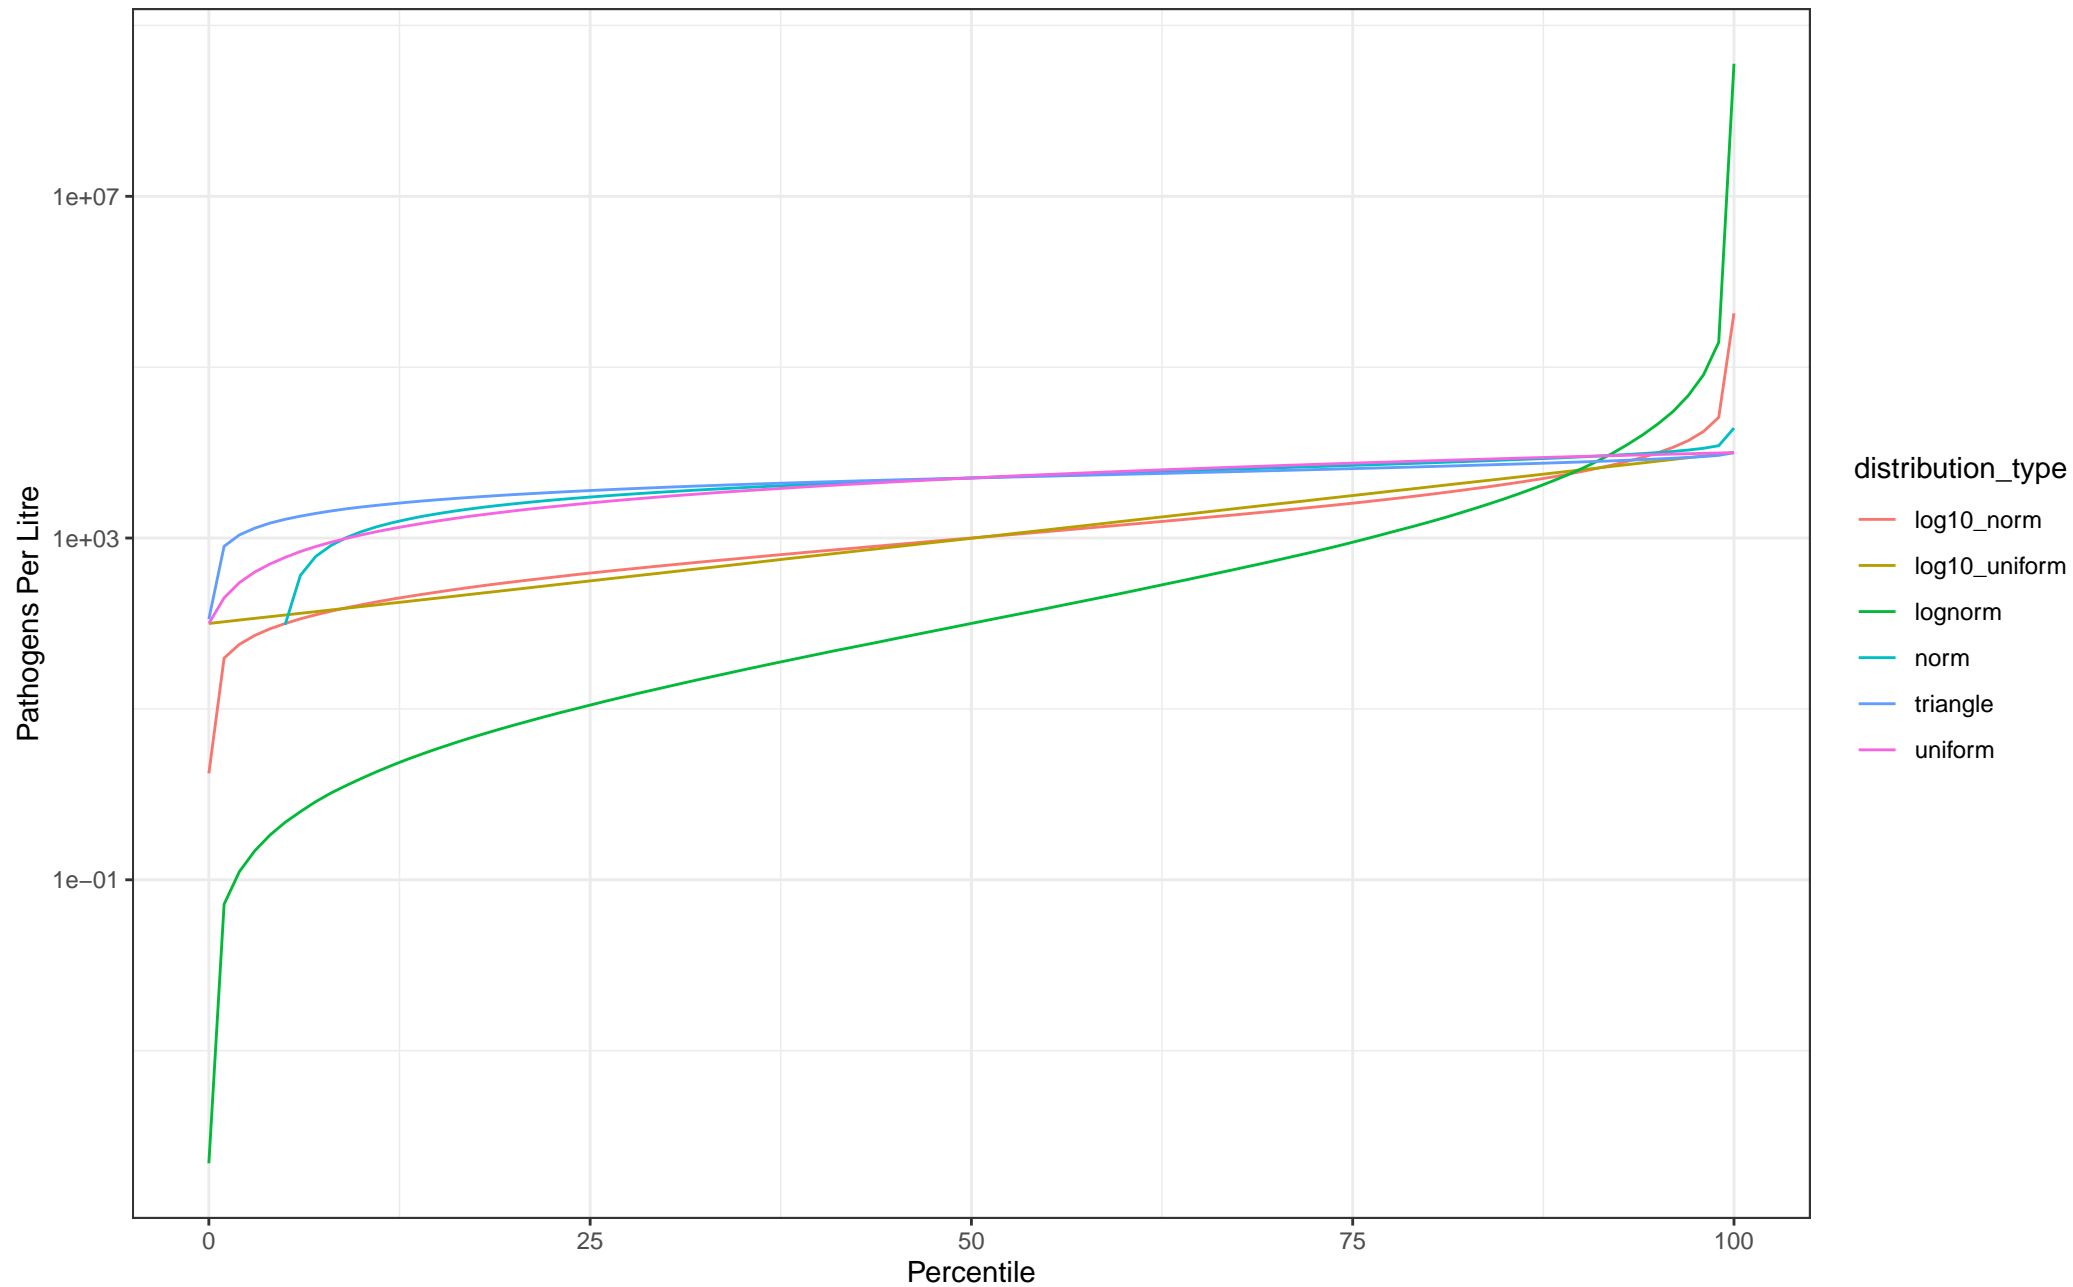


Cryptosporidium parvum (water source: surface water, general):
min = 0.000000, max = 1000.000000

Reference: [WHO (2011): Drinking water guideline, Table 7.6](http://apps.who.int/iris/bitstream/10665/44584/1/9789241548151_eng.pdf#page=159)

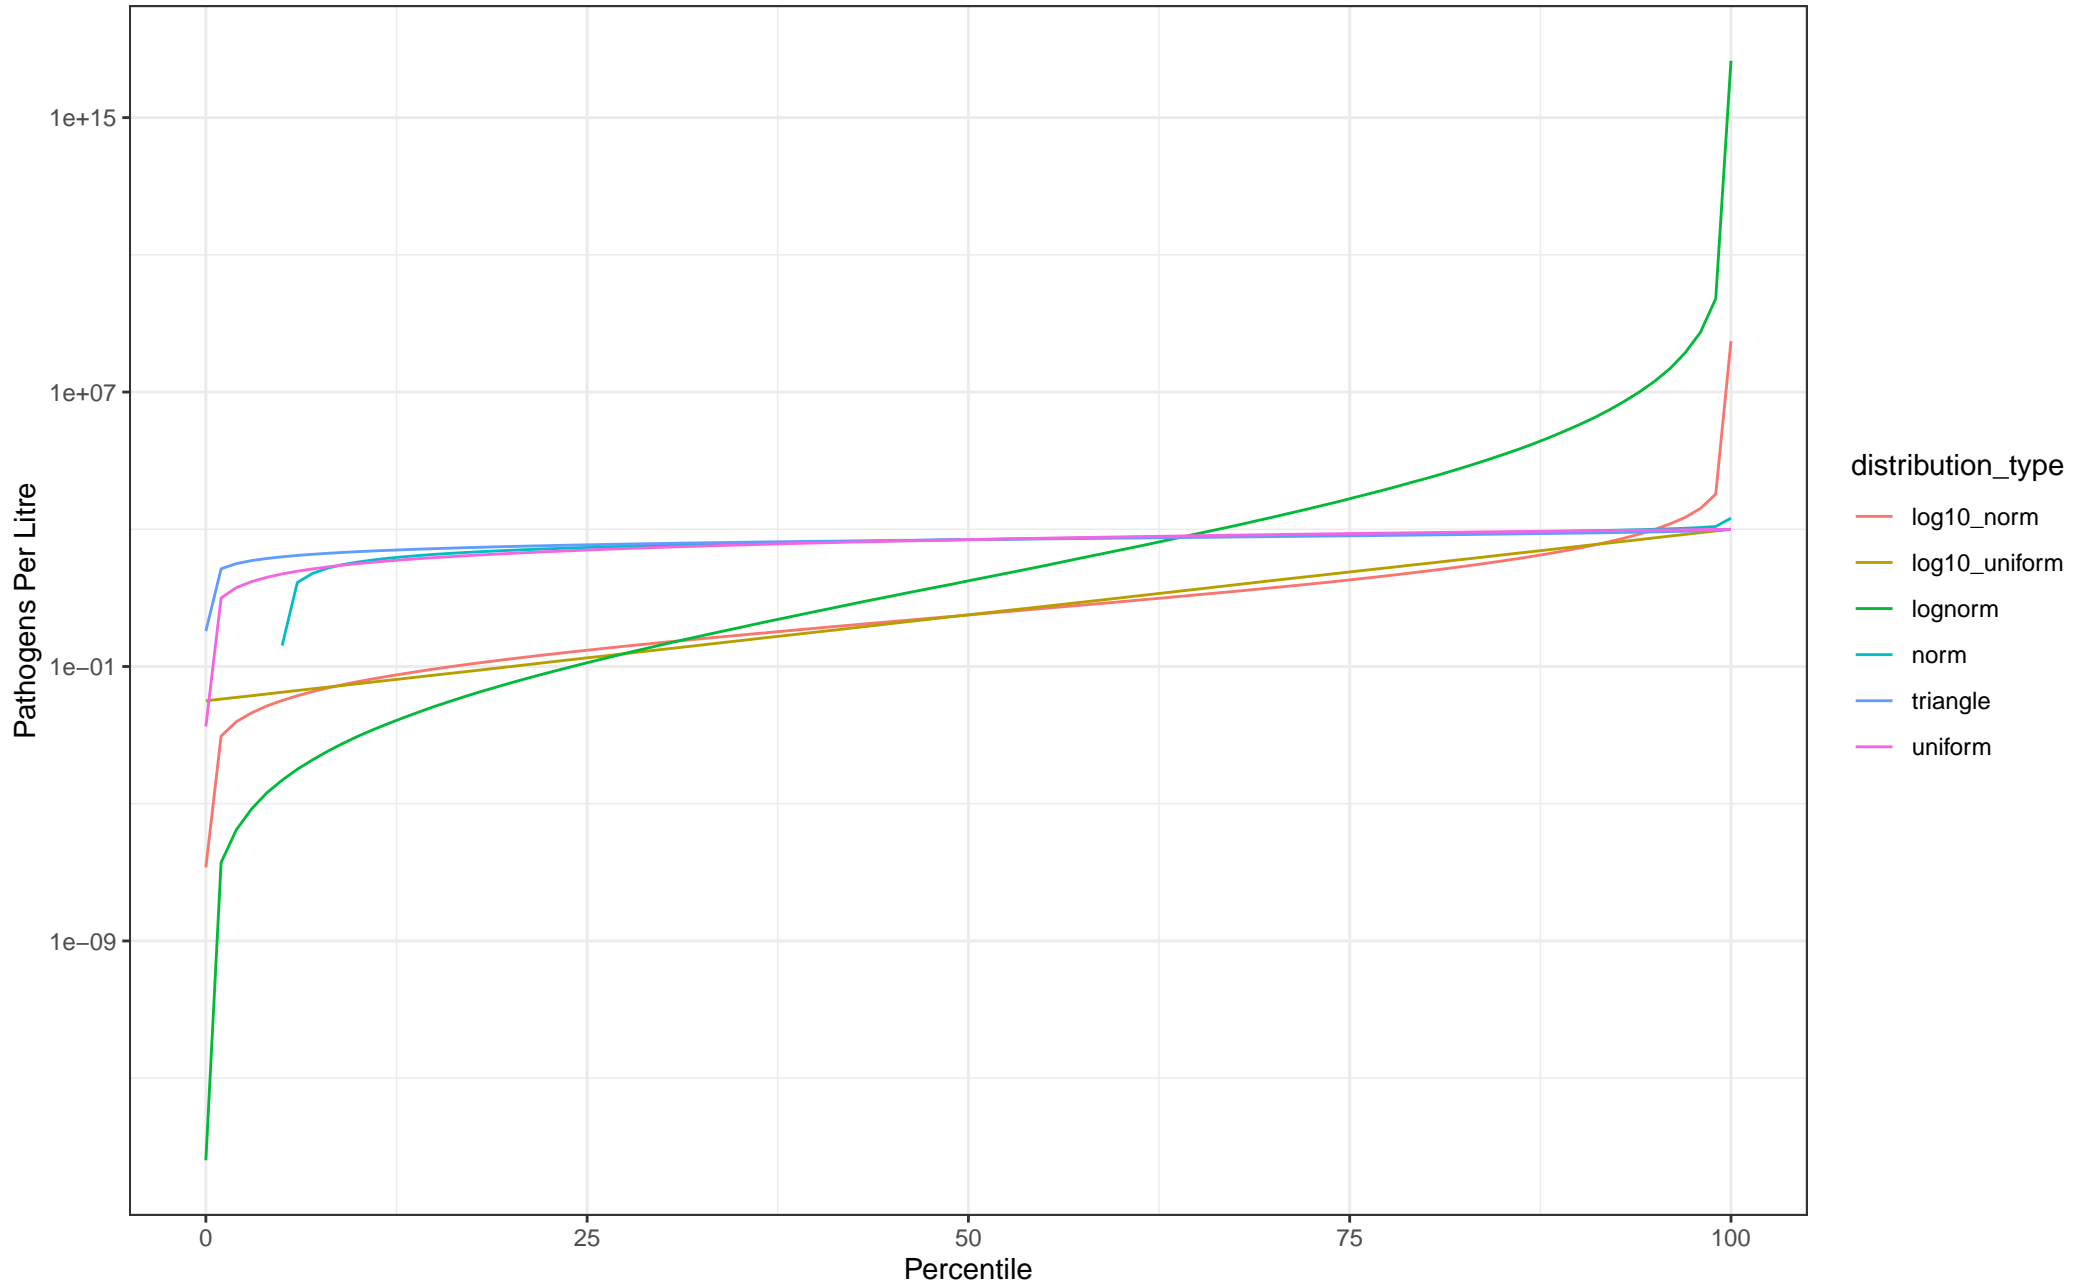

Rotavirus (water source: surface water, general):
min = 0.010000, max = 100.000000


Reference: [WHO (2011): Drinking water guideline, Table 7.6](http://apps.who.int/iris/bitstream/10665/44584/1/9789241548151_eng.pdf#page=159)

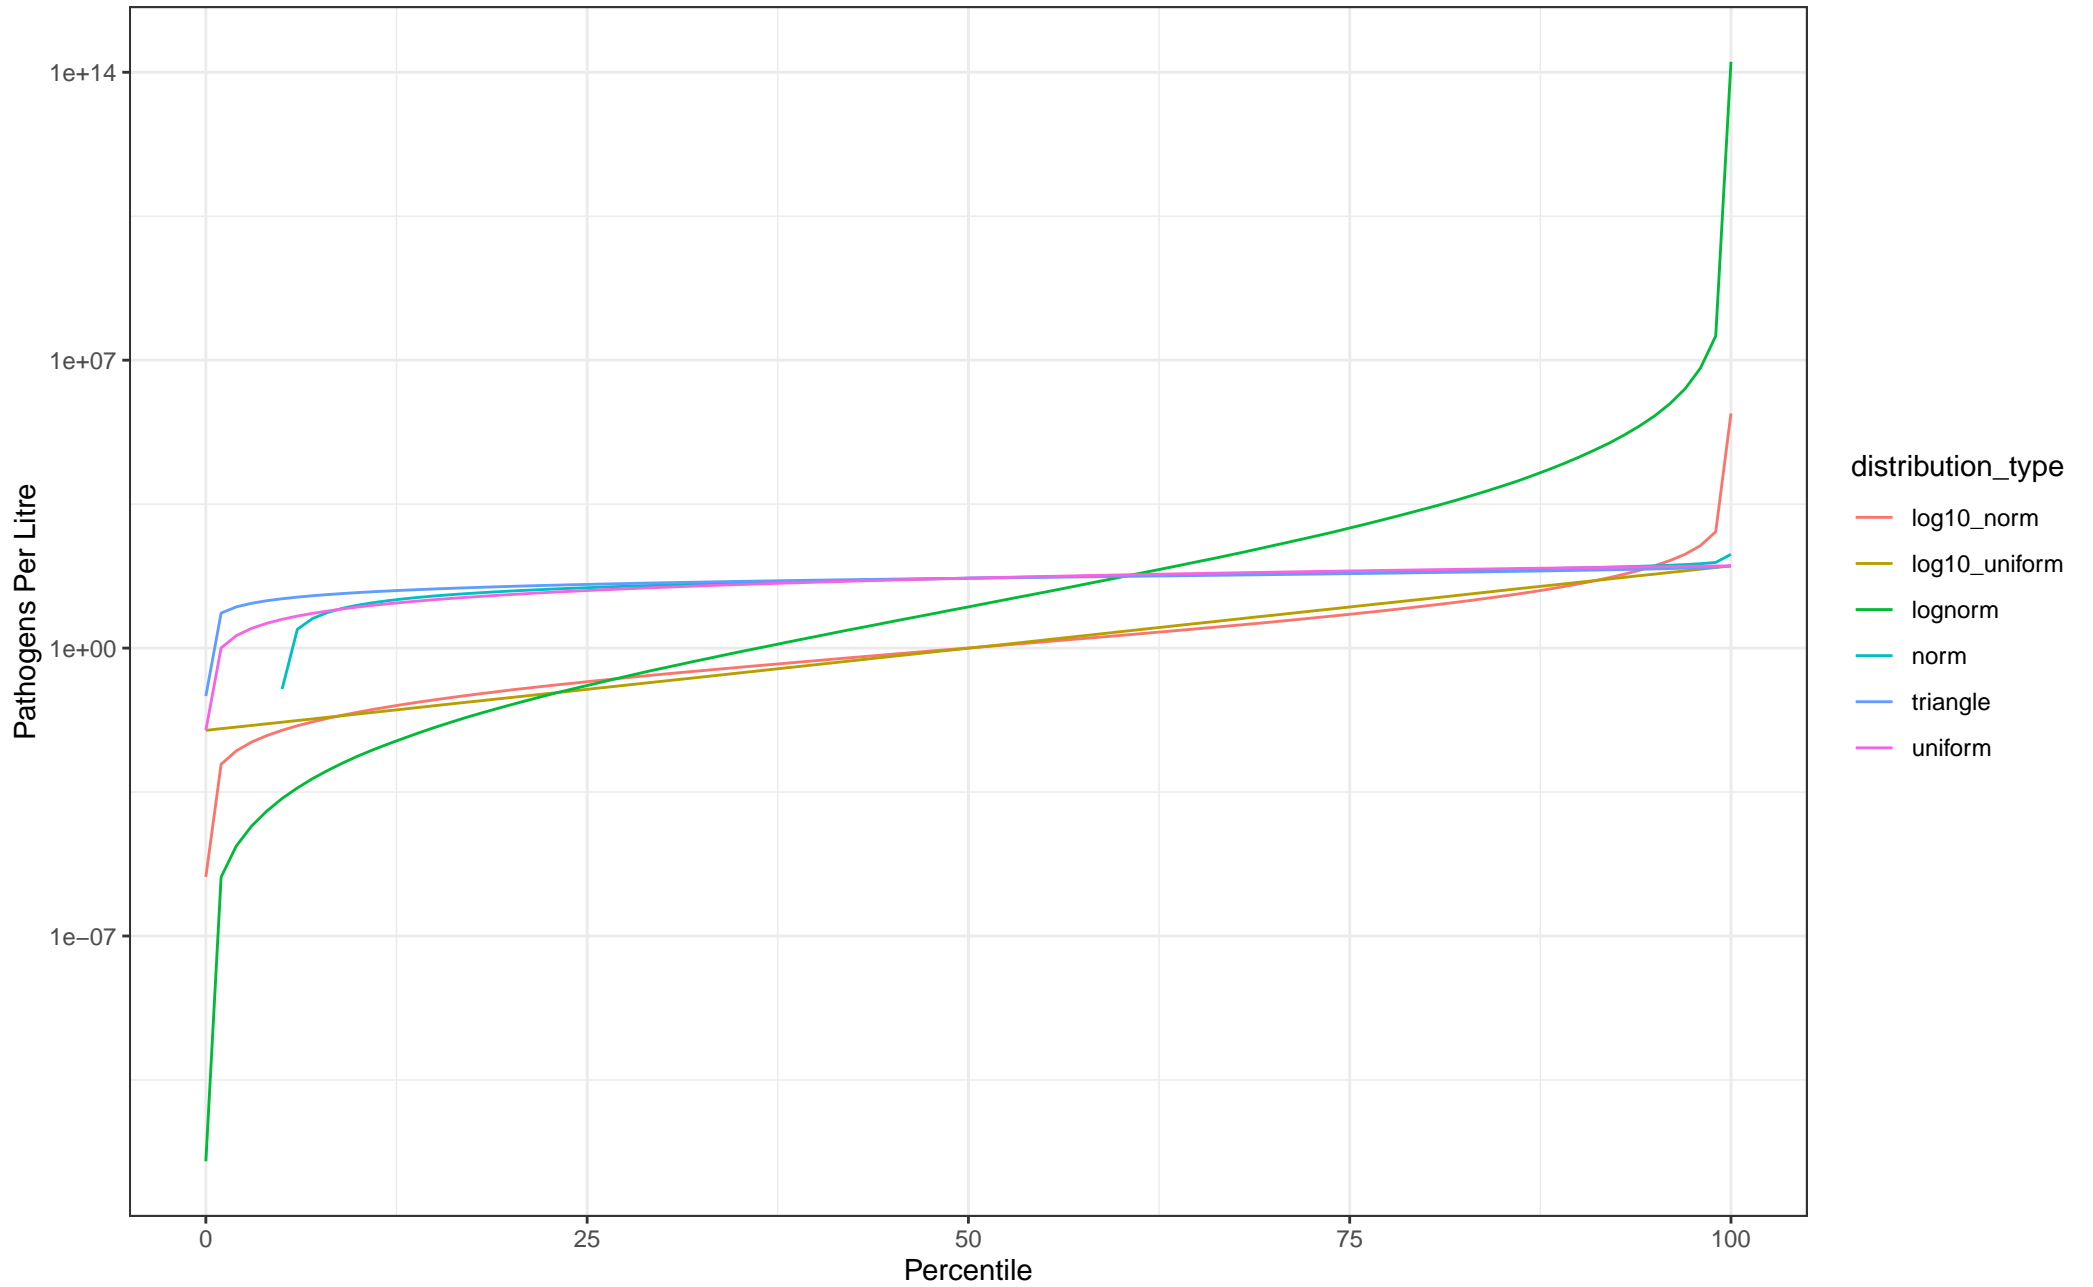

Campylobacter jejuni (water source: surface water, protected):


min = 0.000000, max = 1100.000000

Reference: [WHO GDWQ (2004)](http://www.who.int/water_sanitation_health/dwq/GDWQ2004web.pdf)

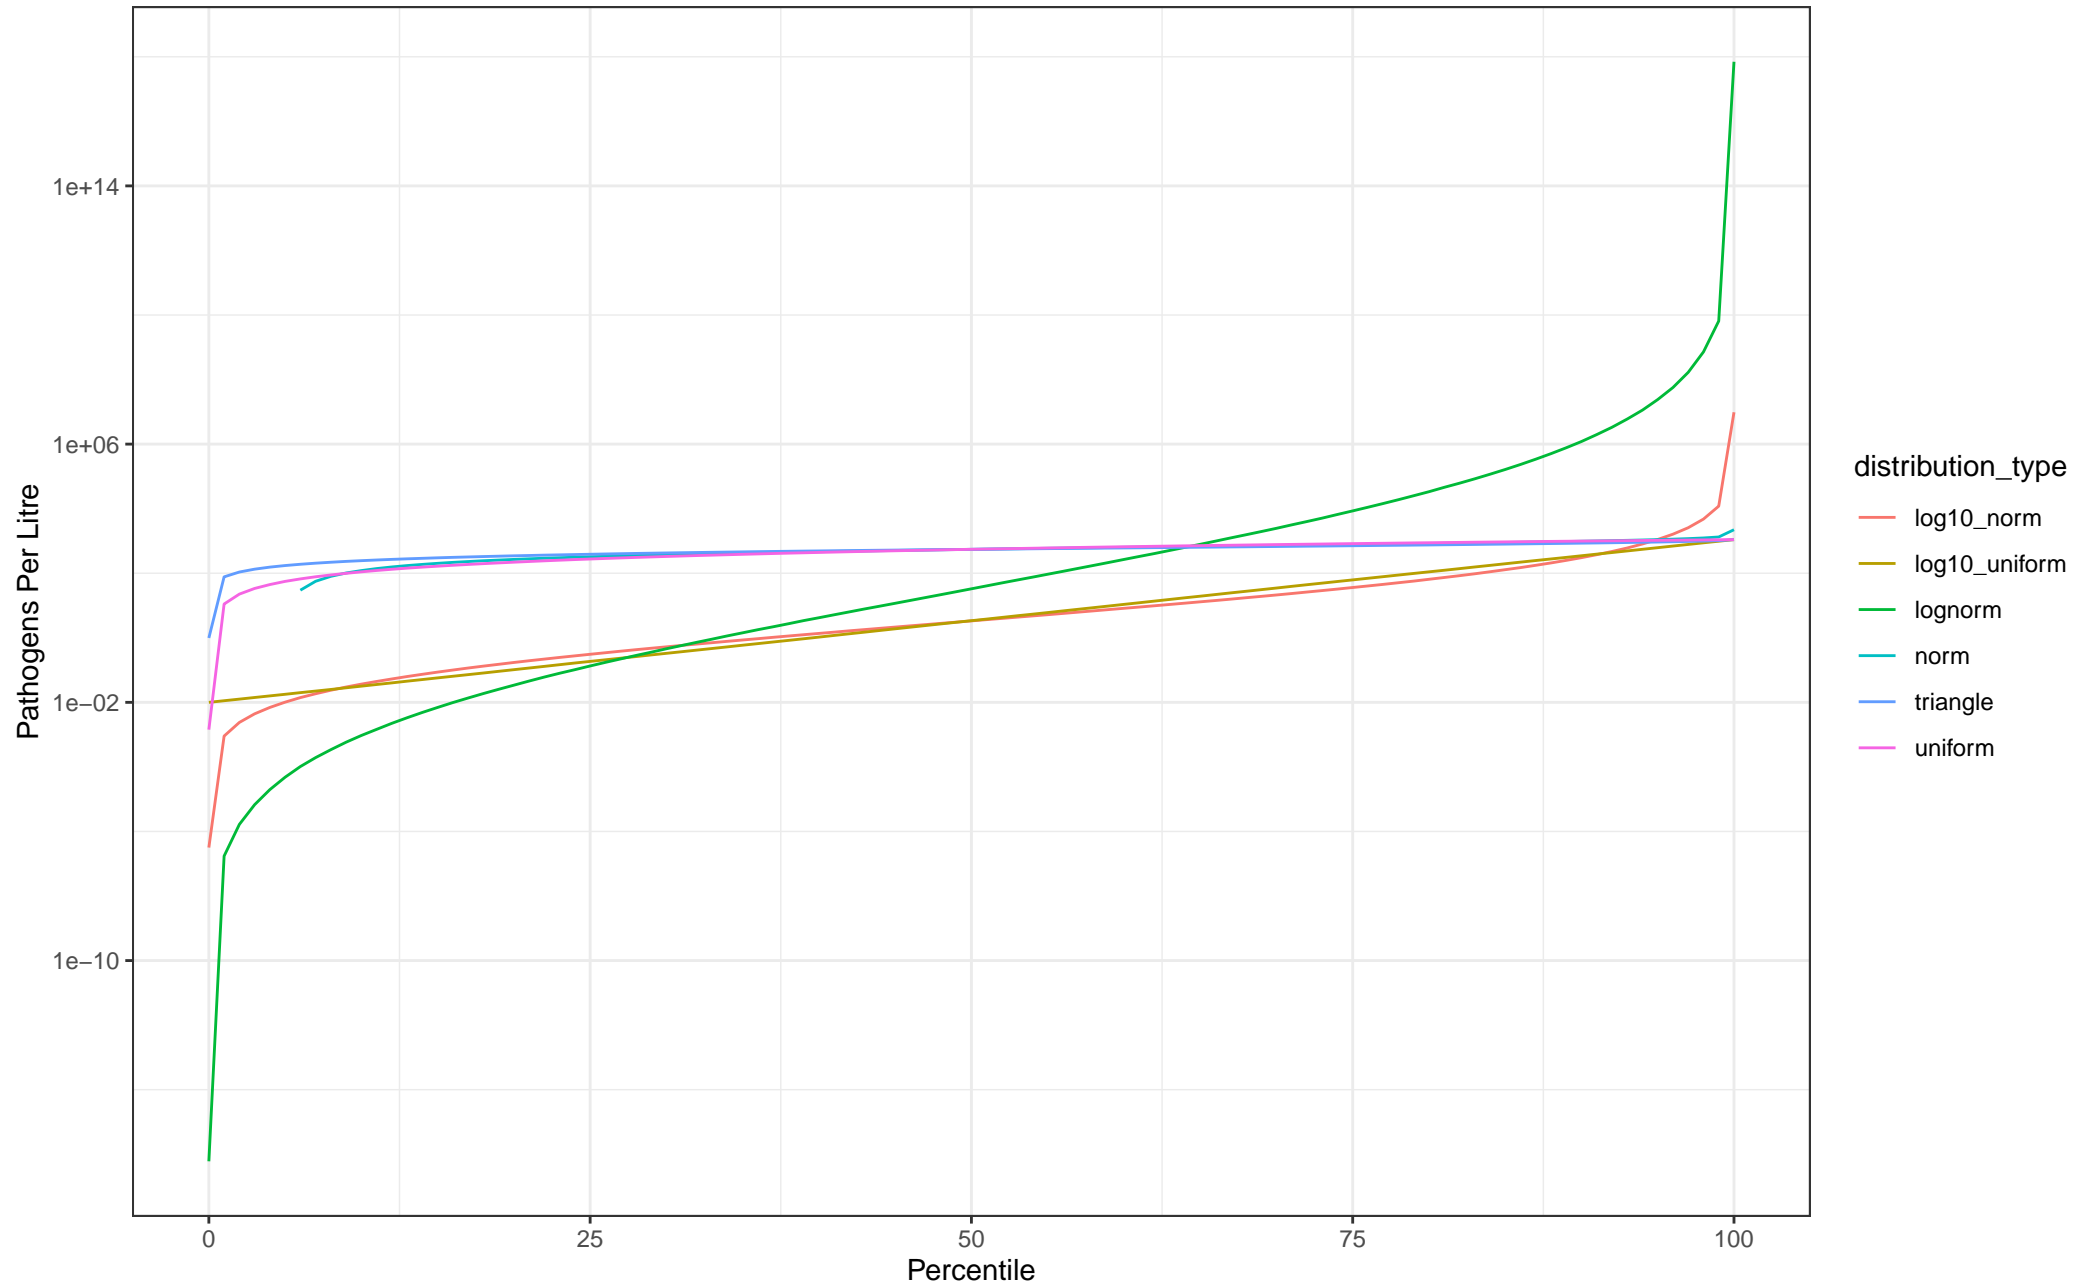

Cryptosporidium parvum (water source: surface water, protected):
min = 2.000000, max = 240.000000

Reference: [WHO GDWQ (2004)](http://www.who.int/water_sanitation_health/dwq/GDWQ2004web.pdf)

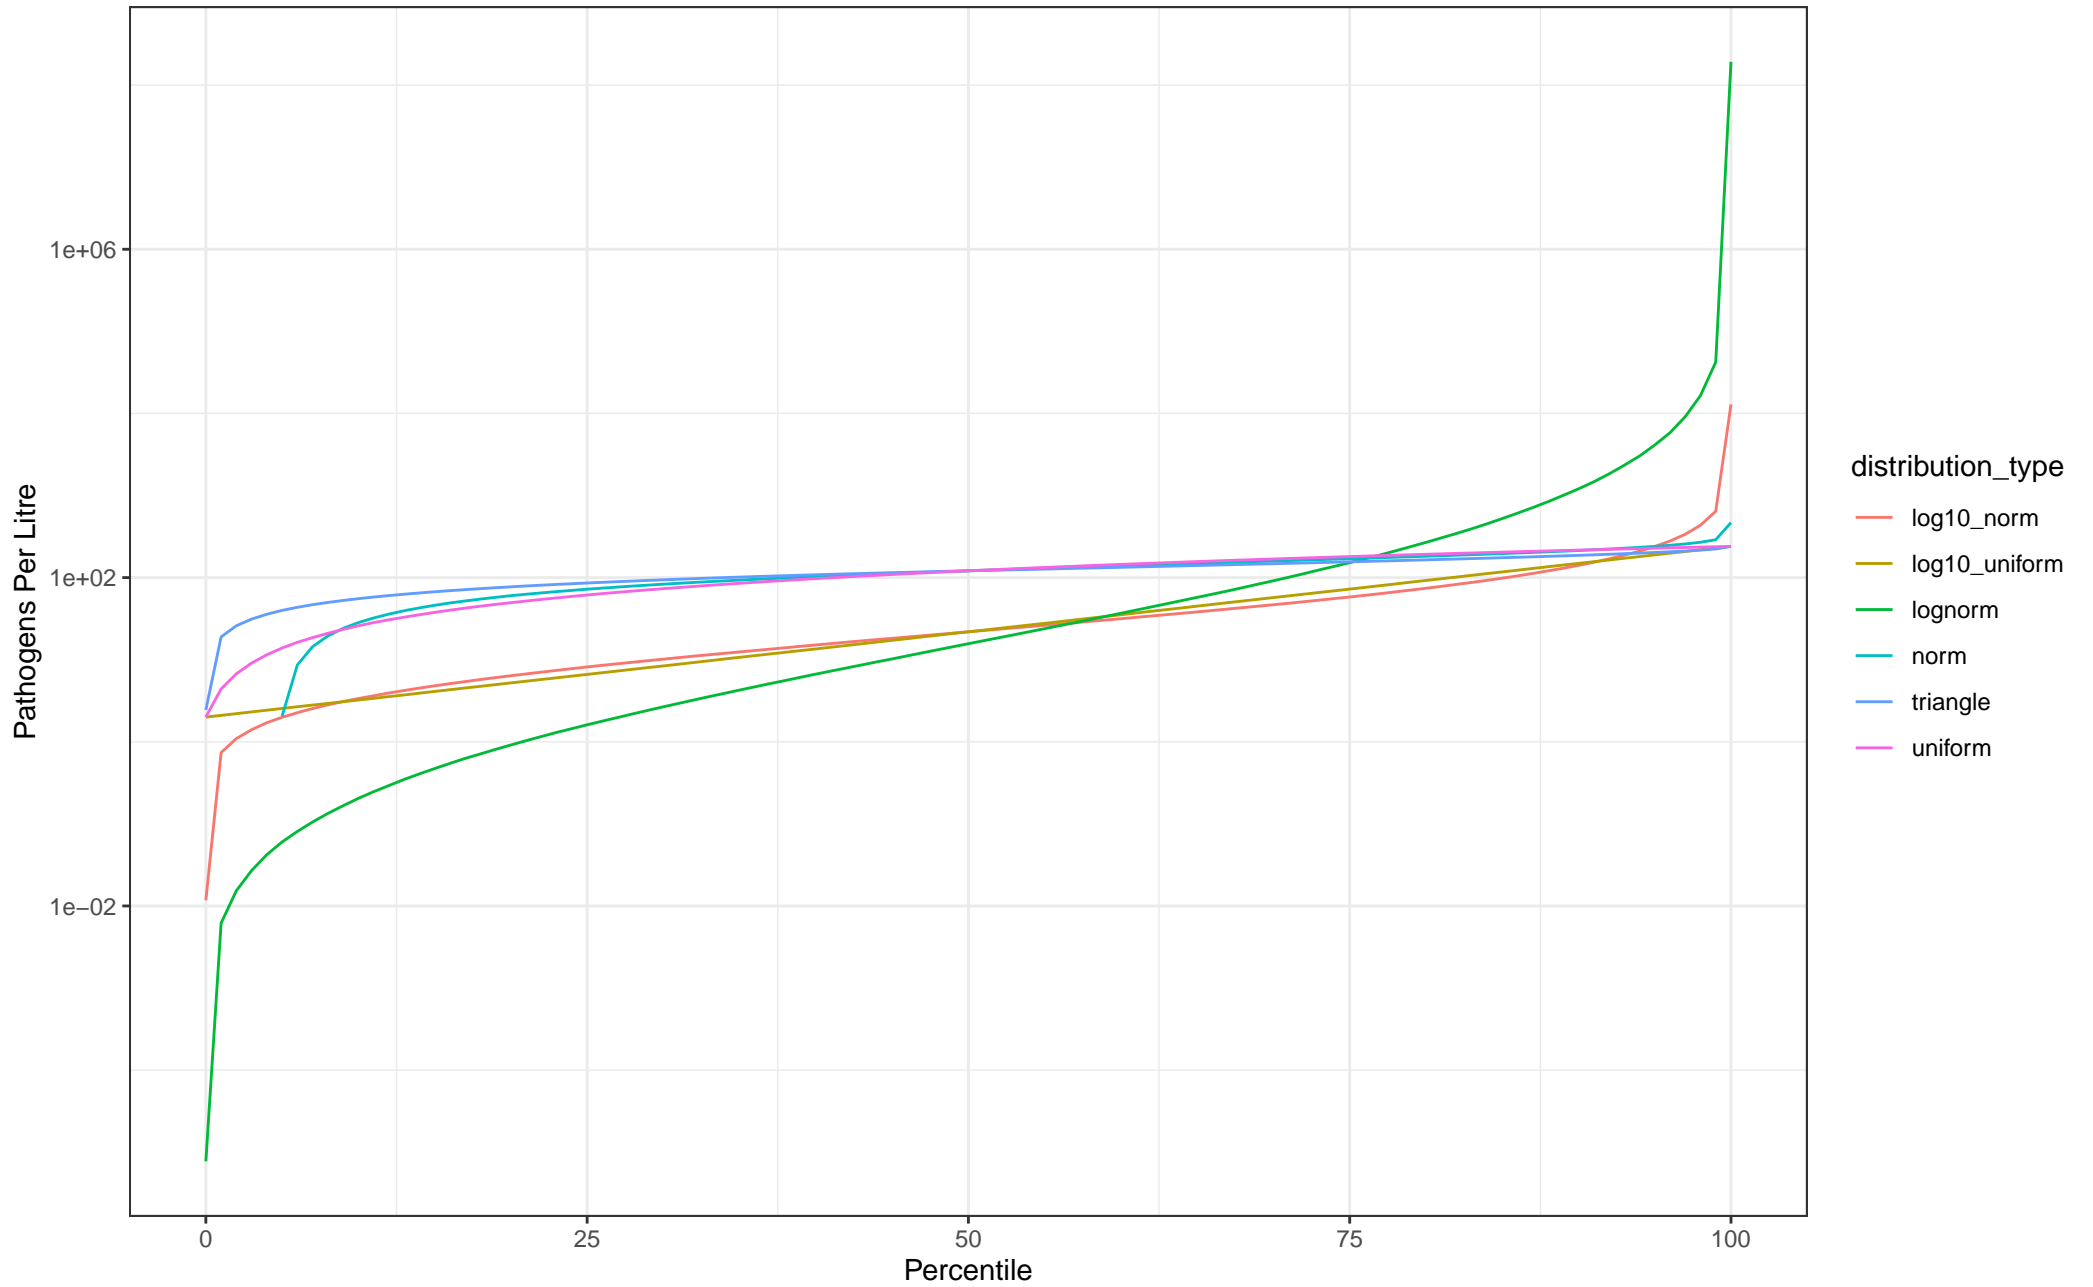

Rotavirus (water source: surface water, protected):

min = 0.000000, max = 3.000000

Reference: [WHO GDWQ (2004)](http://www.who.int/water_sanitation_health/dwq/GDWQ2004web.pdf)

